

File No. 210536

Committee Item No. 5

Board Item No. 21

COMMITTEE/BOARD OF SUPERVISORS

AGENDA PACKET CONTENTS LIST

Comm: Public Safety & Neighborhood Services

Date: Sept. 9, 2021

Board of Supervisors Meeting:

Date: Sept. 21, 2021

Cmte Board

- | | | |
|-------------------------------------|-------------------------------------|--|
| <input type="checkbox"/> | <input type="checkbox"/> | Motion |
| <input type="checkbox"/> | <input type="checkbox"/> | Resolution |
| <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | Ordinance - VERSION 3 |
| <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | Legislative Digest - VERSION 3 |
| <input type="checkbox"/> | <input type="checkbox"/> | Budget and Legislative Analyst Report |
| <input type="checkbox"/> | <input type="checkbox"/> | Youth Commission Report |
| <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | Introduction Form |
| <input type="checkbox"/> | <input type="checkbox"/> | Department/Agency Cover Letter and/or Report |
| <input type="checkbox"/> | <input type="checkbox"/> | MOU |
| <input type="checkbox"/> | <input type="checkbox"/> | Grant Information Form |
| <input type="checkbox"/> | <input type="checkbox"/> | Grant Budget |
| <input type="checkbox"/> | <input type="checkbox"/> | Subcontract Budget |
| <input type="checkbox"/> | <input type="checkbox"/> | Contract/Agreement |
| <input type="checkbox"/> | <input type="checkbox"/> | Form 126 – Ethics Commission |
| <input type="checkbox"/> | <input type="checkbox"/> | Award Letter |
| <input type="checkbox"/> | <input type="checkbox"/> | Application |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Public Correspondence |

OTHER

- | | | |
|-------------------------------------|-------------------------------------|---|
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | <u>SFPUC Presentation – September 9, 2021</u> |
| <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <u>CEQA Determination – July 8, 2021</u> |
| <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <u>SFPUC Memo – April 16, 2021</u> |
| <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <u>Referrals FYI and CEQA – May 19 and July 2, 2021</u> |
| <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <u>Hearing Notice – August 29 and Sept. 3, 2021</u> |

Prepared by: John Carroll

Date: Sept 3, 2021

Prepared by: John Carroll

Date: Sept. 17, 2021

Prepared by: John Carroll

Date: _____

1 [Health, Business and Tax Regulations Codes - Alternate Water Sources for Non-Potable
2 Applications]

3 **Ordinance amending the Health Code to 1) lower the threshold, from 250,000 to 100,000**
4 **square feet of gross floor area, for requiring that new buildings be constructed,**
5 **operated, and maintained using specified alternate water sources for required non-**
6 **potable uses; 2) exempt certain affordable housing projects and property uses from**
7 **that requirement; 3) require that certain categories of new buildings use specific**
8 **sources of nonpotable water for specific purposes; 4) require that new developments with**
9 **multiple buildings install an alternate water source system serving the entire development; 5)**
10 **modify certain administrative review fees; and 6) require the payment of excess use**
11 **charges and penalties for failure to properly use and maintain alternate water source**
12 **systems; amending the Business and Tax Regulations Code to update certain annual**
13 **license fee amounts for operating alternate water source systems; and 6) the completion**
14 **of reports on purified water, recycled water, and Non-potable District Systems; and affirming**
15 **the Planning Department’s determination under the California Environmental Quality**
16 **Act.**

17 NOTE: **Unchanged Code text and uncodified text** are in plain Arial font.
18 **Additions to Codes** are in *single-underline italics Times New Roman font*.
19 **Deletions to Codes** are in *strikethrough italics Times New Roman font*.
20 **Board amendment additions** are in double-underlined Arial font.
21 **Board amendment deletions** are in ~~strikethrough Arial font~~.
22 **Asterisks (* * * *)** indicate the omission of unchanged Code
23 subsections or parts of tables.

24 Be it ordained by the People of the City and County of San Francisco:

25 Section 1. Environmental Findings.

1 The Planning Department has determined that the actions contemplated in this
2 ordinance comply with the California Environmental Quality Act (California Public Resources
3 Code Sections 21000 et seq.). Said determination is on file with the Clerk of the Board of
4 Supervisors in File No. 210536 and is incorporated herein by reference. The Board affirms
5 this determination.

6 Section 2. The Health Code is hereby amended by revising Article 12C, Sections
7 12C.1 through 12C.9 and 12C.11 through 12C.13, to read as follows:

8 **SEC. 12C.1. PURPOSE AND FINDINGS.**

9 The Board of Supervisors finds that:

10 (a) All California water users are responsible for making effective use of the available
11 water resources.

12 (b) The development of alternate water source systems will assist in meeting future
13 water requirements of the City and lessen the impacts of new developments on the City's
14 sewer system.

15 (c) Establishing a regulatory structure that provides administrative efficiency and a
16 streamlined project approval process will assist developers who opt to design, install, operate,
17 and maintain alternate water source systems.

18 (d) Adoption of Article 12C by the Board of Supervisors and adoption of rules and
19 regulations by the Department of Public Health will help achieve the City's goals for water
20 supply use and preservation by:

21 (1) Promoting the values and benefits of non-potable water use while
22 recognizing the need to invest water and other resources as efficiently as possible;

23 (2) Encouraging the use of non-potable water for non-potable applications; and

24 (3) Replacing potable water use for toilet and urinal flushing and irrigation to
25 the maximum extent possible with alternative water sources.

1 (e) It shall be City policy that within five years of the effective date of Ordinance No.
2 109-15, adding this subsection (e) to Article 12C, the City shall use only non-potable water for
3 the purpose of irrigating and cleaning parks, streets, and other public spaces. Within two
4 years of the effective date of that ordinance, the City Administrator, in consultation as
5 appropriate with other City departments, boards, and commissions, including, among others,
6 the Recreation and Park Department, Department of Public Works, Port of San Francisco,
7 San Francisco International Airport, ~~Department~~ Division of Real Estate, and Capital Planning
8 Committee, shall study what will be required to accomplish this policy, including associated
9 costs, and report the results of the study to the Mayor and Board of Supervisors. Upon
10 receiving this study, the Board of Supervisors intends to evaluate any changes to the law and
11 Capital Plan needed to implement this policy.

12 (f) The General Manager of the San Francisco Public Utilities Commission shall submit
13 a report to the Board of Supervisors by December 31, 2021, evaluating the challenges of, and
14 opportunities for requiring the construction, operation and maintenance of Non-potable District
15 Systems at District Development Projects. The report shall also identify the opportunities for
16 the expansion of water heating systems including, but not limited to thermal solar hot water
17 preheating systems, graywater preheating systems, wastewater heat recovery systems, and
18 geo-thermal hot water preheating systems.

19 (g) In order to further determine opportunities to maximize and expand the use of nonpotable
20 sources of water, the General Manager of the San Francisco Public Utilities Commission shall
21 submit to the Board of Supervisors by June 1, 2022, a report evaluating opportunities to develop a
22 recycled water and purified water supply for San Francisco.

23 (h) The General Manager of the San Francisco Public Utilities Commission shall submit
24 a report to the Board of Supervisors by December 31, 2022, identifying the opportunities for
25

1 biogas utilization and energy recovery from the San Francisco Public Utilities Commission's
2 Biosolids Digester Facilities Project.

3 **SEC. 12C.2. DEFINITIONS.**

4 The terms used in this Article 12C have the meaning set forth below:

5 **100% Affordable Housing Project:** a building where 100% of the residential units (not
6 including a manager's unit) have (1) a maximum affordable purchase price or affordable rent set at
7 120% of the unadjusted area median family income as determined by the Mayor's Office of Housing
8 and Community Development on an annual basis and derived from the HUD Metro Fair Market Rent
9 Area that contains San Francisco; (2) a rent that does not exceed 30% of the applicable household
10 income limit for a rental unit, or a purchase price with an annual housing cost that does not exceed
11 33% of the applicable income limit for an owner-occupied unit, as may be adjusted for household size
12 and bedroom count; and (3) a recorded regulatory agreement, consistent with any applicable federal,
13 state, or City government regulatory requirements, to assure that the residential units are sold or
14 rented in accordance with the above criteria for the life of the project or a minimum of 55 years,
15 whichever is shorter.

16 **100% Permanent Supportive Housing Project:** a new building where 100% of the residential
17 units (not including a manager's unit) are (1) owned by a nonprofit charitable organization or qualified
18 related legal entity, (2) used for permanent supportive housing to formerly homeless households subject
19 to a recorded declaration of restriction, and (3) funded through a subsidy agreement with the
20 Department of Homelessness and Supportive Housing.

21 **Alternate Water Source:** a source of ~~non~~Non-potable water that includes Graywater,
22 on-site treated ~~non~~Non-potable water, Rainwater, Stormwater, Foundation Drainage, Blackwater,
23 and any other source approved by the Director.

24 **Alternate Water Source System:** The system of facilities necessary for providing Non-
25 potable Water for use in a Development Project, including but not limited to all collection,

1 treatment, storage, and distribution facilities. Non-potable Water System shall have the same
2 meaning.

3 **Blackwater:** wastewater containing bodily or other biological wastes, as from toilets,
4 dishwashers, kitchen sinks, and utility sinks.

5 **City:** the City and County of San Francisco.

6 **Commercial Building:** a building with a commercial use as defined in Planning Code Section
7 102, amended from time to time.

8 **Condensate:** water vapor collected from air conditioning systems.

9 **Development Project:** Construction of a new building or buildings. Development
10 Projects are Large Development Projects and Small Development Projects. Development
11 Project does not include rehabilitation of buildings constructed prior to August 1, 2015 the
12 effective date of this Article 12C. Development Project does not include (1) any 100% Affordable
13 Housing Project, 100% Permanent Supportive Housing Project, or any housing project funded or
14 constructed pursuant to the HOPE SF Program sponsored and developed by the San
15 Francisco Housing Authority and either the Mayor's Office of Housing and Community
16 Development or the Office of Community Investment and Infrastructure; (2) Hospital Buildings,
17 Health Service Buildings, and Institutional Healthcare Use Buildings; (3) Industrial Use Buildings; (4)
18 Production, Distribution, and Repair Use Buildings; (5) construction of a new building that will
19 receive water service from the San Francisco Public Utilities Commission through no larger
20 than a 5/8" domestic water meter or a 5/8" recycled water domestic meter, as determined in
21 accordance with the San Francisco Public Utilities Commission's rules for water service; (6) for
22 for District projects located within the boundaries of the Reclaimed Water Use Map,
23 construction of new buildings subject to a disposition and development agreement or similar
24 contractual agreement approved before November 1, 2015, that includes in its applicable
25 infrastructure plan the construction and operations of water treatment facilities within the

1 project boundaries that would provide recycled water to the project; (74) for District projects
2 located within the boundaries of the Reclaimed Water Use Map, construction of new buildings
3 subject to a development agreement or similar contractual agreement, within a development
4 phase or subphase, a street improvement plan, or a tentative map or vesting tentative map
5 approved before November 1, 2015; or (85) for District projects located outside the boundaries
6 of the Reclaimed Water Use Map, construction of new buildings subject to a development
7 agreement or similar contractual agreement, within a development phase or subphase, a
8 street improvement plan, or a tentative map or vesting tentative map approved before
9 November 1, 2017.

10 **Director:** the Director of Health or any individual designated by the Director to act on
11 ~~his or her~~ the Director's behalf.

12 **District Development Project:** a Large Development Project consisting of two or more
13 buildings a group of two or more parcels that share Alternate Water Sources.

14 **District System:** An Alternate Water Source System serving a District Development
15 Pproject.

16 **First Certificate of Occupancy:** either a temporary certificate of occupancy or a
17 Certificate of Final Completion and Occupancy as defined in San Francisco Building Code
18 Section 109A, whichever is issued first.

19 **Foundation Drainage:** nuisance groundwater that is extracted to maintain a building's
20 or facility's structural integrity and would otherwise be discharged to the City's sewer system.
21 Foundation Drainage does not include non-potable groundwater extracted for a beneficial use
22 that is subject to City groundwater well regulations.

23 **General Manager:** the General Manager of the San Francisco Public Utilities
24 Commission, or any individual designated by the General Manager to act on his or her behalf.

1 **Graywater:** untreated wastewater that has not been contaminated by any toilet
2 discharge, has not been affected by infectious, contaminated, or unhealthy bodily wastes, and
3 does not present a threat from contamination by unhealthful processing, manufacturing, or
4 operating wastes. "Graywater" includes, but is not limited to, wastewater from bathtubs,
5 showers, bathroom sinks, lavatories, clothes washing machines, and laundry tubs, but does
6 not include wastewater from toilets, kitchen sinks, utility sinks, or dishwashers.

7 **Gross Floor Area:** The floor area of a Development Project as defined in Planning
8 Code Section 102, as amended from time to time.

9 **Health Service Building:** A building with a health service use as defined in Planning Code
10 Section 102, as amended from time to time.

11 **Hospital Building:** A building with a hospital use as defined in Planning Code Section 102, as
12 amended from time to time.

13 **Industrial Use Building:** A building with an industrial use as defined in Planning Code Section
14 102, as amended from time to time.

15 **Institutional Healthcare Use Building:** A building with an institutional healthcare Use as
16 defined in Planning Code Section 102, as amended from time to time.

17 **Large Development Project:**

18 (a) Prior to January 1, 2022, a Large Development Project is the construction ~~Construction~~ of
19 a single building, or construction of multiple buildings on one or more parcels in accordance
20 with a phased plan or approval, with a total ~~gross floor area~~ Gross Floor Area for the single
21 building or the multiple buildings of 250,000 square feet or more:

22 ~~(a)~~ (1) located within the boundaries of the Reclaimed Water Use Map
23 designated in accordance with Sections 1203 and 1209 of the Public Works Code and subject
24 to a site permit or building permit that is final and effective after November 1, 2015; or
25

1 ~~(b)~~ (2) located outside the boundaries of the Reclaimed Water Use Map
2 designated in accordance with Sections 1203 and 1209 of the Public Works Code and subject
3 to a site permit or building permit that is final and effective after November 1, 2016.

4 (b) On or after January 1, 2022, a Large Development Project is the construction of a single
5 building, or construction of multiple buildings on one or more parcels in accordance with a phased
6 plan or approval, with a total Gross Floor Area for the single building or the multiple buildings of
7 100,000 square feet or more.

8 (c) Large Development Projects ~~are not limited to buildings constructed by individuals or~~
9 ~~non-governmental entities but, to the extent allowed by law, also include, to the extent allowed by law,~~
10 buildings constructed and operated by any local, state, or federal government entity, including
11 the City ~~and County of San Francisco.~~

12 **Large Development Project Applicant:** The person or entity applying for
13 authorization to construct and operate a Large Development Project.

14 **Mixed-Use Residential Building:** A building with both a residential use and a commercial use as
15 defined in Planning Code Section 102.

16 **Multi-Family Residential Building:** A building that contains three or more dwelling
17 units.

18 **Non-potable Water:** ~~Non-potable~~ water collected from ~~alternate water sources, Alternate~~
19 ~~Water Sources treated, and intended to be used on the Project Applicant's site or District parcels and is~~
20 ~~suitable for direct beneficial use.~~

21 **Non-potable Water Engineering Report:** Report submitted by the Project Applicant to
22 the Director describing the Alternate Water Source ~~system~~ System in accordance with the rules
23 and regulations adopted by the Department of Health.

24 **Nonpotable Water System:** The same meaning as Alternate Water Source System.
25

1 **Non-residential Residential Building:** A building with a non-residential use as defined in
2 Planning Code Section 102. that contains occupancies other than dwelling units.

3 ~~**NSF 350 System:** Any treatment system certified by NSF International to meet NSF/ANSI~~
4 ~~Standard 350 for Onsite Residential and Commercial Reuse Treatment Systems, as amended from time~~
5 ~~to time.~~

6 **Permittee:** The Project Applicant, or any subsequent owner, assignee, successor in interest or
7 any other transferee subject to this Article 12C, including, but not limited to, operations and
8 maintenance of an Alternative Water Source System. Permittee includes, but is not limited to, the
9 owner of the common areas within a District Development Project and any homeowners association or
10 similar entity that maintains the common areas within a District Development Project. Permittee does
11 not include the Project Applicant, subsequent owners, assignees, successors in interests, transferees,
12 owners of a common area, homeowners associations, or any other person or entity associated with a
13 Development Project serviced by an Alternative District System dedicated to the City in accordance
14 with Section 12C.4(h) of this Article 12C.

15 ~~The operator of an Alternate Water Source System under this Article 12C, including, but not~~
16 ~~limited to, a third-party contractor obtained for the purpose of operating and maintaining all or any~~
17 ~~portion of the Alternate Water Source System.~~

18 **Production, Distribution, Repair Use Building:** A building with production, distribution, repair
19 Use as defined in Planning Code Section 102.

20 **Project Applicant:** the person or entity applying for authorization to install and use an
21 Alternate Water Source ~~System~~project.

22 **Rainwater:** precipitation collected from roof surfaces or other manmade, aboveground
23 collection surfaces.

24 ~~**Responsible Party:** The Project Applicant, or any subsequent owners, assignees, successors in~~
25 ~~interest or any other transferees responsible for compliance with this Article 12C. Responsible Party~~

1 ~~includes, but is not limited to, the owner of the common areas within a District Development Project~~
2 ~~and any homeowners association or similar entity that maintains the common areas within a District~~
3 ~~Development Project. Responsible Party does not include the Project Applicant, subsequent owners,~~
4 ~~assignees, successors in interests, transferees, owners of common area, homeowners associations, or~~
5 ~~any other person or entity associated with a Development Project serviced by an Alternative District~~
6 ~~System as described in Section 12C.4(d).~~

7 **Small Development Project:**

8 (a) Prior to January 1, 2022, a Small Development Project is the construction ~~Construction~~ of
9 a single building, or construction of multiple buildings on one or more parcels in accordance
10 with a phased plan or approval, with a total ~~gross floor area~~ Gross Floor Area for the single
11 building or the multiple buildings of 40,000 square feet or more, but less than 250,000 square
12 feet.

13 (b) On or after January 1, 2022, a Small Development Project is the construction of a single
14 building, or construction of multiple buildings on one or more parcels in accordance with a phased
15 plan or approval, with a total Gross Floor Area for the single building or the multiple buildings of
16 40,000 square feet or more, but less than 100,000 square feet.

17 (c) Small Development Projects ~~are not limited to buildings constructed by individuals or~~
18 ~~non-governmental entities but, to the extent allowed by law, also include, to the extent allowed by law,~~
19 buildings constructed and operated by any local, state, or federal government entity, including
20 the City ~~and County of San Francisco.~~

21 **Small Development Project Applicant:** The person or entity applying for authorization
22 to construct and operate a Small Development Project.

23 **Small Residential Building:** A building that contains no more than two dwelling units.

24 **Stormwater:** Precipitation collected from at-grade or below-grade surfaces.

1 **Water Budget:** The calculation of the potential volume of onsite ~~alternate water~~ Alternate
2 Water Source supplies and demands of a Development Project and any other building subject
3 to this Article 12C.

4 **Water Budget Calculator:** The water use calculation ~~application~~ tool approved by the
5 General Manager that provides for the assessment of a proposed onsite water system,
6 ~~alternate water source~~ Alternate Water Source, and the end uses of the Alternate Water Source.

7 **Water Budget Documentation:** An in-depth assessment of the Project Applicant's
8 non-potable water use, including survey information, water meter readings, water service
9 billing information, Alternate Water Source schematic drawings, or any other information
10 deemed necessary by the General Manager. For proposed District Systems, Water Budget
11 Documentation shall include implementation information that, at a minimum, shall address
12 potential infrastructure and public right of way conflicts, demonstrate compliance with all
13 applicable requirements, and establish the capabilities of the Development Project Applicant
14 to effectively operate the District System.

15
16 **SEC. 12C.3. APPLICABILITY.**

17 (a) This Article 12C shall apply to the installation and operation of the Alternate Water
18 Source ~~systems~~ Systems at Large Development Projects, and to the voluntary installation and
19 operation of the Alternate Water Source ~~systems~~ Systems at sites containing ~~multi-family~~ Multi-
20 Family Residential Building and ~~non-residential~~ Non-Residential buildings. This Article does not
21 apply to:

22 (1)-(a) Systems at ~~small residential~~ Small Residential Buildings ~~occupancies~~.

23 (2)-(b) Graywater systems where Graywater is collected solely for subsurface
24 irrigation and does not require disinfection, as determined by the Director.

1 (3)-(e) Rainwater systems where Rainwater is collected solely for subsurface
2 irrigation, drip irrigation, or non-sprinkled surface applications and does not require
3 disinfection, as determined by the Director.

4 (b) Nothing in the ordinance in Board File No. 201536 amending this Article 12C is
5 intended to impair or limit any contract right that exists as of the effective date of said
6 ordinance. In connection with the application of Article 12C as it relates to development
7 agreements or similar development contracts, or approved development plans administered
8 by the Office of Community Investment and Infrastructure, the General Manager shall consult
9 with the City Attorney to determine whether the application of this Article 12C to a specific
10 Development Project will violate the terms of contracts that the City entered into before the
11 mentioned effective date.

12 **SEC. 12C.4. DEVELOPMENT PROJECT REQUIREMENTS.**

13 (a) Large Development Projects shall be constructed, operated, and maintained in
14 compliance with the following:

15 (1) For Large Development Projects and District Development Projects that
16 submit an application for a site permit on or prior to January 1, 2022, an Alternate Water Source
17 System shall be constructed, operated, and maintained. All toilet and urinal flushing and irrigation
18 demands shall be met through the collection and reuse of available onsite Rainwater,
19 Graywater, and Foundation Drainage, to the extent required by application of the Water
20 Budget Documentation developed for each Development Project.

21 (2) For Large Development Projects and District Development Projects
22 consisting solely of a single Commercial Buildings that submit an application for a site permit after
23 January 1, 2022, an Alternate Water Source System shall be constructed, operated, and maintained.
24 Toilet and urinal flushing demands and drain trap priming are required non-potable uses. The
25 collection and reuse of Blackwater and Condensate (required Alternate Water Sources) shall be

1 used for required non-potable uses to the extent required by application of the Water Budget
2 Documentation.

3 (3) For Large Development Projects and District Development Projects
4 consisting solely of a single Multi-Family Residential Buildings or Mixed-Use Residential Buildings
5 that submit an application for a site permit after January 1, 2022, an Alternate Water Source System
6 shall be constructed, operated, and maintained. Toilet and urinal flushing, clothes washing, drain
7 trap priming, and irrigation demands are required non-potable uses. The collection and reuse of
8 Graywater and Condensate (required Alternate Water SourceS) shall be used for required non-
9 potable uses to the extent required by application of the Water Budget Documentation.

10 (4) For District Development Projects that consist of any combination of
11 Commercial, Residential and Mixed-Use Residential Buildings, and that install a District
12 System, toilet and urinal flushing, clothes washing, drain trap priming, and irrigation demands
13 are required non-potable uses. The collection and reuse of Graywater and Condensate
14 (required Alternate Water Sources) shall be used for required non-potable uses to the extent
15 required by application of the Water Budget Documentation.

16 (5) For District Development Projects that consist of any combination of
17 Commercial, Residential and Mixed-Use Residential Buildings, and that install building-by-
18 building Alternate Water Source Systems, the required non-potable uses and required
19 Alternate Water Sources shall be the uses and sources for each category of building type
20 describe in subsections (a)(2) and (a)(3) of this section.

21 ~~—(4) For District Development Projects consisting of solely Commercial~~
22 ~~Buildings that submit an application for a site permit after January 1, 2022, a District System~~
23 ~~shall be constructed, operated and maintained. Toilet and urinal flushing and irrigation~~
24 ~~demands are required non-potable uses. The collection and reuse of Blackwater (required~~
25

1 Alternate Water Source) shall be used for required non-potable uses to the extent required by
2 application of the Water Budget Documentation.

3 ~~—(5) For District Development Projects consisting of any Multi-Family~~
4 ~~Residential Buildings or Mixed Use Residential Buildings that submit an application for a site~~
5 ~~permit after January 1, 2022, a District System shall be constructed, operated, and~~
6 ~~maintained. Toilet and urinal flushing, clothes washing, and irrigation demands are required~~
7 ~~non-potable uses. The collection and reuse of Graywater (required Alternate Water Source)~~
8 ~~shall be used for required non-potable uses to the extent required by application of the Water~~
9 ~~Budget Documentation.~~

10 (b) A Large Development Project Applicant shall use the Water Budget Calculator as
11 follows:

12 (1)(2) For Large Development Projects that submit an application for a site
13 permit on or prior to January 1, 2022, a Large Development Project Applicant shall use the
14 Water Budget Calculator, as provided by the General Manager's rules, to prepare a Water
15 Budget assessing the amount of Rainwater, Graywater, and Foundation Drainage produced
16 on site, and the planned toilet and urinal flushing and irrigation demands.

17 (2) For Large Development Projects that submit an application for a site permit
18 after January 1, 2022, a Large Development Project Applicant shall use the Water Budget Calculator,
19 as provided by the General Manager's rules, to prepare a Water Budget assessing the amount of
20 Alternate Water produced on site by the required Alternate Water Sources, and the amount of
21 Alternate Water needed to supply the required non-potable uses.

22 (c) Use of Alternate Water for Large Development Projects shall be as follows:

23 (1) For Large Development Projects that submit an application for a site permit
24 on or prior to January 1, 2022, if ~~H~~, based on the Water Budget Documentation, the available
25 supply from onsite sources exceeds the demands for toilet and urinal flushing and irrigation,

1 100% of those demands shall be met by using the available onsite sources. If, based on the
2 Water Budget Documentation, the available supply from onsite sources is less than the
3 demands for toilet and urinal flushing and irrigation, 100% of the available onsite supply shall
4 be used to meet the demands for toilet and urinal flushing and irrigation. Available
5 Blackwater or Stormwater supplies may be used instead of, or in addition to Rainwater,
6 Graywater, and Foundation Drainage to meet the available onsite supply requirements
7 calculated in accordance with the Water Budget Documentation requirements of this Section
8 12C.4~~(a)~~(c)(1).

9 _____ (2)~~(3)~~ *For Large Development Projects that submit an application for a site*
10 *permit after January 1, 2022, if, based on the Water Budget Documentation, the available supply from*
11 *required Alternate Water Sources exceeds the demand from required non-potable uses, 100% of that*
12 *demand shall be met by using the required Alternate Water Sources. If, based on the Water Budget*
13 *Documentation, the available supply from required Alternate Water Sources is less than the demand*
14 *from required non-potable uses, 100% of the available supply from required Alternate Water Sources*
15 *shall be used to meet the demand from required non-potable uses.*

16 (d) Small Development Project Applicants shall *be as follows:*

17 _____ (1) *For Small Development Projects that submit an application for a site permit*
18 *on or prior to January 1, 2022, Small Development Project Applicants shall use the Water Budget*
19 *Calculator, as provided by the General Manager's rules, to prepare a Water Budget*
20 *assessing the amount of Rainwater, Graywater and Foundation Drainage produced on site,*
21 *and the planned toilet and urinal flushing and irrigation demands.*

22 _____ (2) *For Small Development Projects that submit an application for a site permit*
23 *after January 1, 2022, Small Development Project Applicants shall use the Water Budget Calculator,*
24 *as provided by the General Manager's rules, to prepare a Water Budget assessing the supply from*
25 *Alternate Water Sources available on site, and the demand from non-potable uses on site.*

1 (e) Large Development Projects and District Development Projects shall be subject to
2 excess use charges for exceeding potable water allocations determined in accordance with rules
3 adopted by the General Manager. If a Large Development Project or District Development Project
4 exceeds its allocation of potable water, the Permittee for the Large Development Project or District
5 Development Project shall be subject to excess use charges on each unit of potable water exceeding
6 the allocation at 300% (or 3x) the applicable water and wastewater rates.

7 (f) Large Development Projects and District Development Projects shall not provide Non-
8 potable Water to water users or for purposes located outside the boundaries of the Large Development
9 Project or District Development Project, except (1) as permitted in the sole discretion of the General
10 Manager, or (2) when the water users or other purposes are located on property contiguous to, or
11 across a public right of way from the boundaries of the Large Development Project or District
12 Development Project, and the total amount of Non-potable Water produced by the Alternate Water
13 Source System will not exceed 125% of the Large Development Project's or District Development
14 Project's required non-potable demands as determined by the approved Water Budget
15 Documentation.

16 (ge) Additional Requirements for District Systems. All District Systems shall conform
17 to the following requirements, ~~subject to the General Manager's determination, in his or her sole~~
18 ~~discretion, that an exception to any of such requirements will fulfill the purposes and objectives of this~~
19 ~~Article 12C:~~

20 (1) In addition to preparation of the Water Budget, ~~Development~~ Project
21 Applicants for District Systems shall submit implementation plans to the General Manager for
22 review and approval, in accordance with guidelines and rules established by the General
23 Manager.

24 (2) ~~District Systems shall be operated by a single Permittee having sole control~~
25 ~~of operations of all of its facilities, including but not limited to treatment and distribution facilities.~~

1 District Systems shall be constructed in accordance with all applicable City utility standards
2 and specifications.

3 ~~(3) District Systems and Development Projects shall not provide Non-potable~~
4 ~~Water to water users or for purposes located outside the boundaries of the District or approved~~
5 ~~Development Project, except when the water users or other purposes are located on property~~
6 ~~contiguous to, or across a public right of way from the boundaries of the District or approved~~
7 ~~Development Project, and the total amount of Nonpotable Water produced by the Alternate Water~~
8 ~~Source System will not exceed 125% of the District System's or approved Development Project's Non-~~
9 ~~potable Water demands for toilet and urinal flushing and irrigation, as determined by the approved~~
10 ~~Water Budget Documentation.~~

11 ~~—(4) For District Systems, the ongoing operation and maintenance~~
12 ~~responsibilities of the Responsible Party shall be held by the owner of the common areas within the~~
13 ~~District Development Project, and may be transferred to a homeowners association or similar entity~~
14 ~~that maintains the common areas within the District Development Project.~~

15 ~~—Where a District System complies with the requirements in subsections 1 through 4 of this~~
16 ~~subsection 12C.4(e), including any exceptions approved by the General Manager, individual~~
17 ~~Individual buildings within a Development Projects with the District Development Project shall not~~
18 ~~be required to demonstrate compliance as long as the individual buildings Buildings~~
19 ~~Development Projects are provided service by the an approved District System.~~

20 ~~(hd)~~ The General Manager may approve ~~alternative~~ Alternate District Systems that
21 will achieve compliance with the purposes and objectives of this Article 12C, in accordance
22 with guidelines and rules established by the General Manager. Alternative District Systems
23 may include, but are not limited to, the dedication to the City, without cost to the City, of a District
24 System's treatment and/or conveyance system that is constructed in accordance with all applicable
25 utility standards and specifications~~water purchase agreements.~~

1 (i~~e~~) City departments shall not issue an encroachment permit, a site permit, or a
2 plumbing permit for a Large Development Project or a Small Development Project, or
3 approve a Non-potable Water Engineering Report, prior to the General Manager's
4 determination that the Water Budget Documentation has been prepared in accordance with
5 the General Manager's rules for Water Budget calculations.

6 (j~~f~~) Subdivision Approvals.

7 (1) **Parcel Map or Tentative Subdivision Map Conditions.** The
8 Director of Public Works shall not approve a tentative subdivision map or a parcel map for
9 any property unless a condition is imposed requiring compliance with this Article 12C to serve
10 the potential uses of the property covered by the parcel map or tentative subdivision map, as
11 specified in the provisions of this Article.

12 (2) **Subdivision Regulations.** The Director of Public Works shall adopt
13 regulations consistent with, and in furtherance of this Article 12C.

14 (3) **Final Maps.** The Director of Public Works shall not endorse and file a
15 final map for property within the boundaries of the City without first determining that:

16 (A) The subdivider has complied with the conditions imposed
17 on the tentative subdivision map or parcel map, pursuant to this Article 12C; and

18 (B) For any such conditions not fully satisfied prior to the
19 recordation of the final map, the subdivider has signed a certificate of agreement and/or
20 improvement agreement, to ensure compliance with such conditions.

21 (4) This ~~S~~subsection (~~f~~*i*) shall not apply to tentative subdivision maps or
22 parcel maps submitted solely for the purposes of condominium conversion, as defined in
23 Subdivision Code Section 1308(d).

24 (k) In the event that a privately owned Alternate Water Supply System approved by
25 the General Manager is subsequently determined by the California Public Utilities

1 Commission to be subject to that agency’s jurisdiction and regulation, the San Francisco
2 Public Utilities Commission may, with the consent of the affected owner, acquire and operate
3 the facilities.

4 **SEC. 12C.5. REGULATION OF ALTERNATE WATER SOURCES.**

5 (a) Any person or entity who installs and operates an Alternate Water Source
6 system shall comply with this Article 12C, the rules and regulations adopted by the
7 Department of Public Health, and all applicable ~~local~~ City, state, and federal laws.

8 (b) ~~The Within 90 days after passage of this ordinance, the~~ Director shall issue rules and
9 regulations regarding the operation of Alternate Water Source systems necessary to
10 effectuate the purposes of ~~the~~ this Article 12C and to protect public health and safety. These
11 regulations shall address, at a minimum:

- 12 (1) Water quality criteria;
- 13 (2) Monitoring and reporting content and frequencies; and
- 14 (3) Operation and maintenance requirements.

15 (c) The Director shall review applications for Alternative Water Sources systems and
16 may issue or deny such applications, in accordance with applicable laws and regulations.

17 (d) The Department of Building Inspection shall review plans and issue or deny
18 plumbing permits for the construction, installation, or modification of Alternate Water Source
19 systems, in accordance with applicable laws and regulations.

20 **SEC. 12C.6. PROJECT APPLICANT AND/OR PERMITTEE DESIGN AND**
21 **CONSTRUCTION REQUIREMENTS.**

22 (a) Prior to initiating installation of any Alternate Water Source project, Project
23 Applicants shall submit to the Director an application for permits to operate Alternate Water
24 Source systems. Such applications shall comply with the requirements of this Article 12C and
25 any regulations the Director has issued. Project Applicants shall pay a non-refundable permit

1 application fee to cover the costs of investigation and processing the application and issuing
2 the permit. Each project application submitted to the Director shall include a Non-potable
3 Water Engineering Report that provides project information the Director determines to be
4 necessary for complete review of the proposed project. City departments may not approve or
5 issue permits for any site installing an Alternate Water Source system unless and until the
6 Director has approved the Non-potable Water Engineering Report.

7 The Non-potable Water Engineering Report for District systems must include
8 information on the permanent legal agreements between property owners, and provide
9 documentation that each party is a willing and responsible participant in the District Non-
10 potable Water use.

11 (b) System Design. All buildings using Non-potable Water from Alternate Water
12 Source systems shall include:

13 (1) A flow meter on the non-potable distribution system to account for Non-potable
14 Water use;

15 (2) A flow meter on the potable make-up water pipeline to the Alternate Water Source
16 System;

17 (32) A reduced pressure backflow assembly (RP) within 25 feet of the downstream
18 side of the point of connection or meter to protect the City's public water and/or recycled water
19 system;

20 (43) Signage that state law and the Department of Public Health's rules and
21 regulations require;

22 (54) Cross connection control in accordance with California Code of Regulations
23 Titles 17 and 22 and the San Francisco Public Utilities Commission's Cross Connection
24 Control Program; and

1 (65) Any other requirements the Director determines are necessary to protect
2 public health.

3 (c) Plumbing Permit. A Project Applicant shall obtain from the Department of
4 Building Inspection an appropriate plumbing permit and any other building or installation
5 permit required to construct, install, alter, an Alternate Water Source system. Each parcel
6 within a District shall obtain appropriate plumbing and any other building or installation permits
7 required.

8 (d) Encroachment Permit. A Project Applicant shall obtain from the Department of
9 Public Works appropriate authorization for placement of any pipelines or other portions of an
10 Alternate Water Source system within the public right-of-way.

11 (e) Construction Certification Letter. Project Applicants shall certify to the Director
12 that Alternate Water Source system construction is complete and consistent with the
13 approved Non-potable Water Engineering Report in accordance with the provisions of this
14 Article 12C and any implementing rules and regulations. City departments may not approve or
15 issue a First Certificate of Occupancy or approval for any Alternate Water Source system until
16 the Director has reviewed and verified the Construction Certification Letter.

17 **SEC. 12C.7. FEES.**

18 (a) The non-refundable application fees for alternative source water system permits
19 are:

20	(1) Rainwater, <u>Stormwater, Foundation Drainage</u>	<u>\$2,616.28</u> \$1,544.00
21	(2) NSF 350 systems	\$2,688.00
22	(3) Foundation Drainage	\$5,032.00
23	(24) Graywater	<u>\$8,142.66</u> \$5,032.00
24	(35) Blackwater	<u>\$13,958.84</u> \$9,034.00
25	(46) Transfer of any permit	<u>\$226</u> 229.00

1 (57) District Scale, the applicable amount above, plus \$~~226191.00~~ per
2 hour for plan review
3 and/or on-site
4 inspection.

5 (b) The fees set forth in this Section 12C.7 may be adjusted each year, without
6 further action by the Board of Supervisors.

7 Not later than April 1, the Director shall report to the Controller the revenues
8 generated by the fees for the prior fiscal year and the prior fiscal year's costs of operation, as
9 well as any other information that the Controller determines appropriate to the performance of
10 the duties set forth in this Section 12C.7.

11 Not later than May 15, the Controller shall determine whether the current fees
12 produce, or are projected to produce, revenues sufficient to support the costs of providing the
13 services for which the fees are assessed and that the fees will not produce revenue that
14 significantly exceed more than the costs of providing the services for which the fees are
15 assessed.

16 The Controller shall if necessary, adjust the fees upward or downward for the
17 upcoming fiscal year as appropriate to ensure that the program recovers the costs of
18 operation without producing revenue which is significantly more than such costs. The adjusted
19 rates shall become operative on July 1.

20 (c) Every permit holder shall also pay an annual license fee as provided in the
21 Business and Tax Regulations Code Section 249.24.

22 **SEC. 12C.8. OPERATING REQUIREMENTS.**

23 When the Director determines the Project Applicant ~~applicant~~ has satisfied all the
24 requirements of this Article 12C, the Director may issue an operations permit for an
25 Alternative Water Source system. Permittees shall timely submit all water quality monitoring

1 information required by the provisions of this Article and the Department of Public Health's
2 rules and regulations. Permittees shall conduct ongoing backflow prevention and cross
3 connection testing in accordance with this Article, the rules and regulations of the Department
4 of Public Health, and all applicable ~~local~~ City, state, and federal laws.

5 **SEC. 12C.9. NON-POTABLE WATER USE AUDITS.**

6 When required by the General Manager, the Permittee ~~or property owner~~, shall conduct
7 a Non-potable Water use audit describing the extent of Non-potable Water use in accordance
8 with requirements provided by the General Manager.

9
10
11 **SEC. 12C.11. INSPECTION ~~AND NOTICES OF VIOLATION.~~**

12 The Director may inspect any Alternate Water Source system subject to the
13 requirements of this Article 12C to determine compliance with the provisions of this Article
14 and applicable regulations.

15 **SEC. 12C.12. VIOLATION AND PENALTIES.**

16 ~~The Director may impose administrative penalties on any Permittee, or person otherwise~~
17 ~~subject to the requirements of this Article 12C, who violates any provision of this Article or any~~
18 ~~applicable rule or regulation shall be subject to enforcement in accordance with Chapter 100 of the~~
19 ~~San Francisco Administrative Code with respect to administrative penalties, and may pursue any other~~
20 ~~available legal remedies for such violations.~~

21 Administrative penalties shall be assessed and collected by the Department of Public Health as
22 set forth in this Section 12C.12.

23 (a) Any Permittee, or other person otherwise subject to the requirements of this Article 12C,
24 who violates any provision of this Article or any applicable rule or regulation shall be subject to an
25 administrative penalty imposed by order of the Director, not to exceed \$1,000. Each day or portion

1 thereof that a violation exists constitutes a separate and distinct violation for which an administrative
2 penalty may be imposed. In assessing the amount of the administrative penalty, the Director may
3 consider any one or more of the following: the nature and seriousness of the misconduct, the number of
4 violations, the persistence of the misconduct, the length of time over which the misconduct occurred,
5 and the willfulness of the violator's misconduct.

6 (b) If the Director determines that any Permittee, or other person otherwise subject to the
7 requirements of this Article 12C, is in violation of any provision of this Article or any applicable rule
8 or regulation, the Director shall issue a Notice of Violation to the person. The Notice of Violation shall
9 contain the following information: a description of circumstances or condition constituting the
10 violation; the date by which the person must correct the violation; the amount of the administrative
11 penalty that the Director will impose daily until such time as the person has demonstrated to the
12 satisfaction of the Director that the violation has been corrected; and the right to seek administrative
13 review of the Notice of Violation by filing an appeal within 30 days of the date that the Notice of
14 Violation is served to challenge the Director's determination and/or the proposed administrative
15 penalty.

16 (c) If no request for administrative review is timely made, the right to request a hearing shall be
17 waived, and the Director's determination shall become final. The failure to timely request a hearing
18 shall constitute a failure to exhaust administrative remedies and shall preclude judicial review of the
19 validity of the enforcement action. The Director shall issue an order imposing the administrative
20 penalties, which shall be due and payable within 15 days of the date of the order.

21 (d) Administrative penalties assessed by the Director shall be paid to the Treasurer of the City
22 and County of San Francisco and credited to the Public Health Environmental Health Code
23 Compliance Fund, authorized by Administrative Code Section 10.100-193.

24 **SEC. 12C.13. REVOCATION AND SUSPENSION OF PERMIT.**

1 The Director may order a Permittee to cease operation of an Alternate Water Source
2 system, or may revoke or suspend the permit to operate if the Director determines that:

3 (a) The Permittee or its manager_s, operator_s or any employee_s has violated any
4 provision of this Article 12C or any regulation issued pursuant to this Article;

5 (b) The Alternate Water Source system is being operated or maintained in a manner
6 threatening the public health or health of patrons and/or residents; or

7 (c) The Permittee ~~owner or operator~~ has refused to allow any duly authorized City
8 official to inspect the premises or the operations of the Alternate Water Source system.

9
10 Section 3. Article 2 of the Business and Tax Regulations Code is hereby amended by
11 revising Section 249.24, to read as follows:

12
13 **SEC. 249.24. NON-POTABLE WATER SYSTEMS.**

14 Every person, firm, or corporation engaged in operating an alternate water source
15 system that requires a permit from the ~~San Francisco~~ Department of Public Health shall pay an
16 annual license fee to the Tax Collector in the amount listed below. For the purpose of this
17 Section 249.24, the term "alternate water source ~~system~~systems" shall have the same meaning
18 as that in Article 12C of the ~~San Francisco~~ Health Code.

19	(a) Rainwater, <u>Stormwater, and Foundation Drainage</u>	\$1,613.45 <u>\$472.00</u>
20	(b) NSF 350 systems	\$ 929.00
21	(c) Foundation Drainage	\$1,387.00
22	(db) Graywater	\$2,195.07 <u>\$1,387.00</u>
23	(ec) Black water	\$2,195.07 <u>\$1,844.00</u>

24 The license fee set forth above shall be paid annually on or before March 31, in
25 accordance with the provisions of Section 76.1 of the Business and Tax Regulations Code.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25

Section 4. Scope of Ordinance. In enacting this ordinance, the Board of Supervisors intends to amend only those words, phrases, paragraphs, subsections, sections, articles, numbers, punctuation marks, charts, diagrams, or any other constituent parts of the Municipal Code that are explicitly shown in this ordinance as additions, deletions, Board amendment additions, and Board amendment deletions in accordance with the “Note” that appears under the official title of the ordinance.

Section 5. Effective Date. This ordinance shall become effective 30 days after enactment, except as otherwise stated in this ordinance. Enactment occurs when the Mayor signs the ordinance, the Mayor returns the ordinance unsigned or does not sign the ordinance within ten days of receiving it, or the Board of Supervisors overrides the Mayor’s veto of the ordinance.

APPROVED AS TO FORM:
DENNIS J. HERRERA, City Attorney

By: /s/ John Roddy /s/
JOHN RODDY
Deputy City Attorney

n:\legana\as2021\2100104\01525586.docx

REVISED LEGISLATIVE DIGEST
(Amended in Committee – September 9, 2021)

[Health, Public Works, Business and Tax Regulations Codes - Alternate Water Sources for Non-Potable Applications]

Ordinance amending the Health Code to 1) lower the threshold, from 250,000 to 100,000 square feet of gross floor area, for requiring that new buildings be constructed, operated, and maintained using specified alternate water sources for required non-potable uses; 2) exempt certain affordable housing projects and property uses from that requirement; 3) require that certain categories of new buildings use specific sources of nonpotable water for specific purposes; 4) modify certain administrative review fees; 5) require the payment of excess use charges and penalties for failure to properly use and maintain alternate water source systems; and 6) the completion of reports on purified water, recycled water, and Non-potable District Systems; amending the Business and Tax Regulations Code to update certain annual license fee amounts for operating alternate water source systems; and affirming the Planning Department’s determination under the California Environmental Quality Act.

Existing Law

Under section 4.110 of the Charter, the Health Commission and the Department of Public Health (“Department”) are generally authorized to provide for the preservation, promotion and protection of the physical and mental health of the inhabitants of the City and County. The Charter also provides that the Commission and the Department may also determine the nature and character of public nuisances and provide for their abatement.

Article 12C to the San Francisco Health Code contains laws that implement the Health Commission and the Department’s authority to provide for the preservation, promotion and protection of the physical and mental health of the inhabitants of the City and County. The Article requires that persons desiring or required to implement alternative source water systems obtain permission to construct and operate such systems, in accordance with the rules and regulations established by the Department that define appropriate water quality standards, monitoring criteria and other requirements for such systems. The Article also directs the Department of Building Inspection to review plans and to issue plumbing permits for on-site alternative water source systems.

Article 12C applies to and authorizes the installation and operation of the alternate water source systems at sites containing multi-family and non-residential buildings. New development projects of 250,000 square feet or more of gross floor area that did not receive a site permit prior to November 1, 2016 are required to construct, operate, and maintain an onsite non-potable water system to treat and reuse available sources of rainwater, graywater, blackwater and foundation drainage for toilet and urinal flushing and irrigation.

The amounts and types of water sources available for such new development projects will be assessed by using the San Francisco Public Utilities Commission's (SFPUC) Water Budget Calculator. If the Water Budget Calculator assessment shows that the available supply from onsite sources exceeds the demands for toilet and urinal flushing and irrigation, 100% of those demands must be met by using the available onsite sources. If the Water Budget Calculator assessment shows that the available supply from onsite sources is less than the demands for toilet and urinal flushing and irrigation, 100% of the available onsite supply must be used to meet the demands for toilet and urinal flushing and irrigation.

New development projects of 40,000 square feet or more of gross floor area are not required to construct, operate, and maintain an onsite non-potable water system, but are required to use the Water Budget Calculator to prepare a water budget assessing the amount of available rainwater, graywater, and foundation drainage produced on site, and the planned demands for toilet and urinal flushing and irrigation.

Article 12C requirements do not apply to systems at small residential occupancies, graywater systems where graywater is collected solely for subsurface irrigation and does not require disinfection, as determined by the Director, and rainwater systems where rainwater is collected solely for subsurface irrigation, drip irrigation, or non-sprinkled surface applications and does not require disinfection, as determined by the Director.

Article 12C requires a project applicant to submit an engineering report to the Department that describes the design of the proposed alternative source water system and clearly indicates the means for compliance with the Department's rules and regulations. The Department will review the engineering report and issue a permit to operate the system, if the system complies with the applicable rules and regulations.

Under Article 12C, the Department of Building Inspection (DBI) will provide final inspection and sign-off to ensure that appropriate bypass and cross-connection control elements as part of construction. The Article also provides authority to perform water use audits, approve permit transfers on point of sale of the property, suspend or revoke permits, and to abate violations, including the imposition of penalties pursuant to Administrative Code chapter 100.

Article 12C also provides for the payment of fees to cover the Department's costs for administering the program and, by adding section 249.24 to the Business and Taxation Code, for the payment of an annual license fee to the Tax Collector.

Amendments to Current Law

The draft ordinance proposes the following changes:

- Lowers the threshold for applicability of Article 12C to large development projects from a total gross floor area for the single building or the multiple buildings of 250,000 square feet or more, to a total gross floor area for the single building or the multiple buildings of 100,000 square feet or more.
- Exempts from applicability the following development projects: 100% affordable housing projects; 100% permanent supportive housing projects; hospital buildings; health service buildings; institutional healthcare use buildings; industrial use buildings; and production, distribution, and repair use buildings.
- Requires commercial building development projects to reuse blackwater for indoor uses.
- Requires multi-family and mixed-use residential building development projects to provide graywater for clothes washing as an end use.
- Removes enforcement of rainwater collection and reuse as a required alternate water source.
- Increases Department fees to cover the administrative costs of performing inspections and approval and oversight functions.
- Modifies Department enforcement tools to create consistency with current Department procedures and increases potential penalties for non-compliance.
- Requires the San Francisco Public Utilities Commission to complete reports regarding recycled water use and development, sustainable water heating systems, and the potential uses of renewable natural gas.
- Clarifies that development projects are subject to excess use charges for failure to comply with obligations under Article 12C to use alternate water sources.

Background Information

The City's Non-Potable Water Program is administered through an inter-agency partnership among the Department, SFPUC, DBI, and SFPW. The purpose of this program is to create a streamlined process for new large developments in San Francisco to collect, treat, and use non-potable water on-site for toilet flushing, irrigation, and other non-potable applications. Non-potable is a term that refers to water that is not of drinking water quality, but can be used

for other productive uses such as toilet flushing and irrigation, in compliance with applicable City, State and Federal laws.

According to the SFPUC, non-potable water is used across the nation to reduce the pressure on natural water resources. Treated non-potable water can be used for a number of beneficial purposes, including irrigation, toilet flushing, decorative fountains, dust control and cooling applications. Capturing and treating rainwater, foundation drainage, and graywater – and then reusing the water for toilet flushing and irrigation – could result in a dramatic reduction in the overall water footprint of a building. Furthermore, using on-site sources may reduce the volume of flows into the sewer. Reducing the volume of rainwater and wastewater flowing into the combined sewer system, especially during the rainy season, can help reduce the risk of combined sewer discharges.

Under this program, several types of alternate water sources generated on site can be collected and treated, including:

Rainwater – precipitation collected from roofs and above-grade surfaces.

Graywater – wastewater collected from bathtubs, showers, bathroom sinks, clothes washing machines, and laundry tubs, but does not include wastewater from kitchen sinks, toilets or dishwashers.

Foundation Drainage – nuisance groundwater that is dewatered to maintain a building's structural integrity and would otherwise be discharged to the City's sewer system. Foundation drainage is not the same as non-potable groundwater, which requires a production well and is already regulated by City ordinance.

Stormwater – precipitation collected at or below grade surfaces.

Blackwater – wastewater collected from toilets, dishwashers, kitchen sinks and utility sinks.

Non-potable water cannot be used for drinking, washing or bathing, washing of clothing, washing of food, washing of cooking or eating utensils, washing of food preparation or processing premises, or other personal service rooms. Rainwater, however, is often allowed for clothes washing and recycled water is allowed for commercial laundries. The City's Non-Potable Water Program is designed for new, large-scale commercial, mixed-use, and multifamily residential developments installing on-site systems to capture, treat, and reuse water for toilet flushing, irrigation, and other non-potable applications. Single-family residential properties are the focus of other programs developed by the SFPUC, namely the Laundry-to-Landscape Pilot Graywater Program, the Graywater Permit Rebate Program, and the Discounted Rain Barrel and Cistern Program, and therefore are not included in this Non-Potable Water Program.

Typical elements of an alternative water source system may include:


- Collection: Plumbing used to collect on-site supplies, such as graywater, and convey it to a treatment system.
- Storage (Collection): Storage tank used to equalize collection flows prior to treatment.
- Treatment System: A System that processes untreated water with filtration, disinfection, and/or other processes to achieve acceptable water quality results.
- Treated Water Storage: Storage tank used to store treated graywater, rainwater, or foundation drainage water after treatment and before distribution.
- Distribution System: (pumps and piping): Distribution pumps to convey water from the treated storage tank to designated fixtures in the building via non-potable distribution plumbing. Distribution system piping is completely separate from other piping in a building and is used to convey the treated non-potable supplies to specific uses such as toilet flushing.

Non-potable Water Ordinance Updates

Board of Supervisors Public Safety and Neighborhood Services Committee

John Scarpulla
September 9, 2021

Non-potable Water Ordinance

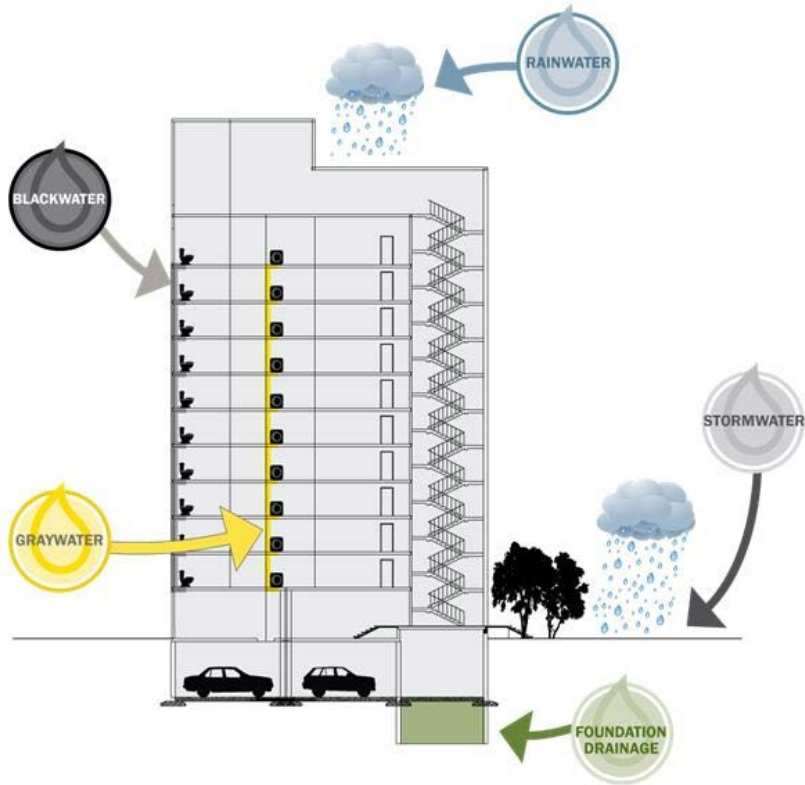

- Applies to new buildings and development projects 250,000 gross square feet or greater
- Required to treat and reuse graywater, rainwater, and foundation drainage to meet toilet flushing and irrigation demands onsite
- Applicable city-wide



Non-potable Ordinance Requires City Family Coordination

SFPUC	SFDPH-EH	SFDBI	SFPW
Program Administration and Cross-Connection Control	Environmental Health	Construction	Right of Way and Mapping
<p>Review onsite non-potable water supplies & demands</p> <p>Administer citywide project tracking & annual potable offset achieved</p> <p>Provide technical support & outreach to developers</p> <p>Manages Cross-Connection Control Program</p>	<p>Issue water quality & monitoring requirements</p> <p>Review and approve non-potable engineering report</p> <p>Issue permit to operate onsite systems</p> <p>Review water quality reporting</p>	<p>Conduct Plumbing Plan check and issue Plumbing Permit</p> <p>Inspect and approve system installations</p>	<p>Issue Encroachment Permits as needed for infrastructure in the Right-of-Way (if needed)</p> <p>Includes condition on a subdivision map or a parcel map requiring compliance with the Non-potable Ordinance prior to approval and issuance of said map (if applicable)</p>


San Francisco's Evolving Onsite Water Reuse Program

2012



*Single
Building*

2013

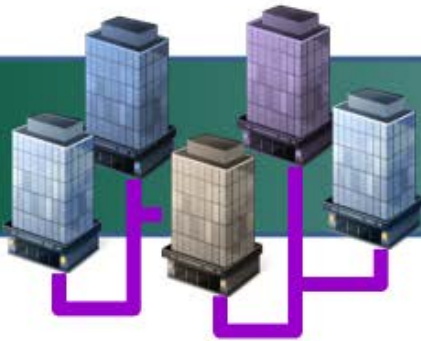

*District-
Scale*

2015




*Mandatory for \geq
250,000 gsf*

2019



*Innovations: Brewery
Process Water Reuse*

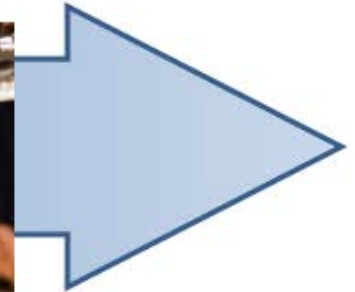

Examples of Mandatory NPO Projects



Mission Rock



Fifteen Fifty Mission



Chase Center

Proposed NPO Amendments



- Opportunity to further increase potable water offsets from new buildings and development projects
- Analysis of NPO program resulting in streamlined ordinance requirements
- Increased opportunities for cost-effective systems

Proposed NPO Amendments



- Lower square footage threshold to any building(s) over 100,000 gross square feet
- Buildings that are 100% commercial to reuse all wastewater, not just graywater, onsite
- Multi-family residential and mixed-use residential buildings to meet clothes washing demands in addition to toilet flushing and irrigation demand

Additional Proposed NPO Amendments

- Exempt:
 - 100% affordable housing and homeless supportive housing
 - Hospital, health service, and institutional health care facilities
 - Facilities zoned for Production, Distribution, Repair (PDR) and industrial use
- Require A/C condensate to be reused
- Require projects to reuse water onsite for drain trap priming
- Collection and reuse of rainwater will be allowed not required
- Modify SFDPH penalty structure to improve enforcement and increase SFDPH application fee to cover oversight

Proposed NPO Amendments



- Opportunity to further increase potable water offsets from new buildings and development projects
- By 2040, mandatory NPO projects can achieve water savings equivalent to 26,200 SF residents daily water use
- Amendments can achieve additional water savings equivalent to 5,500 SF residents daily water use

Thank you



MEMORANDUM

Executive Summary

In accordance with Ordinance 237-20 that amends the Building Code to require new construction utilize only electric power, the San Francisco Public Utilities Commission (SFPUC) drafted the following report evaluating opportunities for the expansion of non-potable onsite water treatment systems, graywater heat recovery systems, solar thermal water heating, and on-demand hot water heaters.

Through an ongoing evaluation of the SFPUC’s existing water programs, SFPUC staff analyzed the City and County of San Francisco’s Non-potable Water Ordinance to identify opportunities to increase potable water savings from new development projects and improve system implementation. Staff examined the three potential modifications to the ordinance for new development projects of 250,000 gross square feet (gsf) or greater and are recommending San Francisco move forward with the following:

- Requiring blackwater reuse in commercial buildings;
- Requiring graywater reuse for toilet and urinal flushing, clothes washing, and irrigation in multi-family and mixed-use residential buildings; and
- Requiring district-scale water reuse systems in development projects with more than one building.

Staff also examined the potential for lowering the 250,000 gsf threshold for compliance with the Non-potable Ordinance to 100,000 gsf. Staff analyzed the result this would have on achieving additional potable water savings. By lowering the threshold, this would only realize an additional 0.02 mgd of potable water savings which represents just 2% of the total savings anticipated for the developments projects that are required to comply with the Non-potable Ordinance by 2040.

In the report, SFPUC staff also included an extensive review of wastewater heat recovery systems, including a description of how the technology works, benefits that could be achieved in buildings with onsite water reuse systems, energy savings potential, and the applicability for San Francisco. For the single-family home scale, staff are not recommending to require the installation of drain-heat recovery systems in new single-family homes due to the fact that there is a limited market for single family home development opportunities in San Francisco and the technical challenges with applying this technology in existing homes. In new, larger development projects that are installing onsite water reuse systems, staff are recommending to continue encouraging wastewater heat recovery systems via the Onsite Water Reuse Grant Program because

London N. Breed
 Mayor

Sophie Maxwell
 President

Anson Moran
 Vice President

Tim Paulson
 Commissioner

Ed Harrington
 Commissioner

Newsha Ajami
 Commissioner

Michael Carlin
 Acting
 General Manager



wastewater heat recovery systems have the potential to significantly offset the energy consumption of onsite water reuse systems. Voluntary use of the technology will allow staff to gather more information about the potential benefits and implementation.

The next section of the report evaluates the potential implementation of solar thermal water heating systems in San Francisco. SFPUC staff reviewed a description of how the technology works, example system costs, and considerations for evaluating the technology in San Francisco. Solar thermal systems are very well suited for rooftop installation and have a proven track record of meeting commercial and residential water heating needed. Therefore, it is recommended that residential properties and commercial businesses that use a lot of hot water in their operations should consider a solar thermal installation. With the high temperatures that can be achieved, the systems can offer value to a wide range of businesses, particularly hotels, restaurants, and laundromats. Consideration should also be given to the fact that qualified solar professionals are needed for the installation, but are in limited supply in the Bay Area.

Lastly, SFPUC staff included a brief overview of a new proposal to launch a pilot program in Fiscal Year 2021-2022 to rebate a portion off the purchase price of installed on-demand recirculating hot water heater pumps and to evaluate their water-savings potential. The target market for the pilot rebate program and study is residential single-family and small multi-family properties in which each dwelling unit has its own hot water tank.

1. SFPUC Water and Power Enterprises

The SFPUC is committed to an innovative approach to water and energy resources management. The SFPUC is implementing several programs and projects that are diversifying the City's water supply portfolio and ensuring resilient water sources for the future. The SFPUC's water conservation program includes many efforts to help residences and business save water. One example is the Plumbing Fixture Replacement Program, a toilet and urinal direct installation program that connects residences and businesses to plumbers for retrofitting inefficient fixtures. Another example is the Leak Alert Program, which notifies customers of a potential leak by sending an email, text, letter, and phone call and advises to contact a plumber. In addition, the SFPUC is committed to developing local groundwater to enhance the City's drinking water supply. The SFPUC also promotes the use of recycled water, as construction continues on the Westside Enhanced Water Recycling Project that will provide recycled water for irrigating Golden Gate Park, Lincoln Park Golf Course, and the San Francisco Zoo. Also underway is a satellite treatment facility feasibility study to evaluate options to deliver recycled water to dual-plumbed buildings on the eastside of San Francisco. In addition, the SFPUC implements the City's mandatory requirement for onsite water reuse in new large buildings. The SFPUC provides grant funding to encourage retail water

users to install onsite water reuse systems, as well as encourage the installation of onsite treatment and reuse of brewery process water.

Additionally, the SFPUC's Power Enterprise provides numerous customer programs to both Hetch Hetchy Power and CleanPowerSF customers. Through rebates, specially designed rates and services, and other incentive structures, these programs help customers use energy as efficiently as possible, save money, and participate in San Francisco's clean energy future.

2. Non-potable Water Ordinance

Recognizing an opportunity in new and large redevelopment projects for onsite use of alternate water supplies in September 2012, the City and County of San Francisco adopted the Non-potable Water Ordinance (NPO). It added Article 12C to the San Francisco Health Code allowing for the collection, treatment, and use of alternate water sources such as graywater, rainwater, stormwater, blackwater, and foundation drainage for non-potable applications such as toilet flushing and irrigation. The following alternate water sources are defined as:

- Graywater: untreated wastewater that includes, but is not limited to, wastewater from bathtubs, showers, bathroom sinks, clothes washing machines, and laundry tubs, but does not include wastewater from kitchen sinks or dishwashers.
- Blackwater: includes graywater and is defined as wastewater containing bodily or other biological wastes, as from toilets, dishwashers, kitchen sinks and utility sinks.
- Rainwater: precipitation collected from roof surfaces or other manmade, above ground collection surfaces.
- Stormwater: precipitation collected from at-grade or below grade surfaces or from any surface where hydrocarbon-based fuels, hazardous materials, or fertilizers are stored or used.
- Foundation drainage: nuisance groundwater that is extracted to maintain a building's or facility's structural integrity and would otherwise be discharged to the sanitary or combined sewer system.

A streamlined permitting process was developed through a joint collaboration with the SFPUC, San Francisco Department of Public Health (SFDPH), San Francisco Department of Building Inspection (SFDBI), and San Francisco Department of Public Works (SFPW). Water quality, monitoring, and reporting requirements were established, giving regulatory oversight and management over onsite non-potable water systems to the Department of Public Health.

In 2013, the Board of Supervisors amended the NPO to allow district-scale non-potable water systems consisting of two or more buildings sharing non-potable water. Subsequently, the Ordinance was amended in July 2015 to mandate the installation of onsite water systems in new developments of 250,000 gross square feet or more. And the Ordinance was amended again in 2016 to clarify implementation requirements for district-scale systems.

3. Onsite Water Reuse Grant Program

The SFPUC's Onsite Water Reuse Grant Program provides grant funding to encourage retail water users to reduce SFPUC water supply usage by collecting, treating, and using alternate water sources including rainwater, stormwater, graywater, foundation drainage, air conditioning condensate, and blackwater for non-potable uses such as toilet flushing, irrigation, and cooling tower makeup. Projects must demonstrate the ability to achieve at least one of the following thresholds to eligible for grant funding:

- Projects that replace at least 450,000 gallons of SFPUC water per year are eligible for grant funding up to \$200,000; or
- Projects that replace at least 1,000,000 gallons of SFPUC water per year are eligible for grant funding up to \$500,000; or
- Projects that replace at least 3,000,000 gallons of SFPUC water per year are eligible for grant funding up to \$1,000,000.

The SFPUC lowered the threshold of eligibility to 450,000 gallons of water per year offset to incentivize existing dual-plumbed buildings with no current recycled water source to install onsite water reuse systems. Recognizing that these buildings would likely otherwise not install onsite water reuse systems, the SFPUC is offering financial assistance to encourage additional potable water savings.

4. Potential Amendments to Non-potable Water Ordinance

Evaluating Impacts to Future Development Projects

Through an ongoing effort to evaluate the SFPUC's existing water programs, SFPUC staff analyzed the Non-potable Water Ordinance to identify opportunities to increase potable water savings from new development projects and improve system implementation. Several potential amendments were identified, which are discussed further below. During the spring of 2020, SFPUC staff met with the city agencies including SFDPH, SFDDBI, SFPW, and SFPUC Water Quality Division that are responsible for implementing the ordinance. The city agencies were given opportunities to comment on the proposed amendments and provide suggestions to further streamline compliance with the ordinance.

To understand the impacts on future multi-family, mixed-use, and commercial development projects and anticipated potable water offsets, SFPUC staff reviewed the San Francisco Planning Department's Pipeline Report published with 2020 Quarter 1 data and internal databases used for tracking future

developments' compliance with the ordinance. SFPUC staff, in consultation with other city agencies, determined that the most streamlined way to apply future potential amendments was to make them applicable to only planned development projects that have not yet filed a site permit. Therefore, SFPUC staff analyzed only planned development projects that have not yet filed for a site permit. Appendix A contains more information on these developments and Table 4 summarizes the number of future development projects and anticipated potable water offsets if the square footage threshold were lowered to 100,000 gsf. In Appendix A, any building marked with a Y in the 'Site Permit Filed or Issued' column was not included in the potable offset analysis for the above stated reason. The buildings with an 'N' were included, and the total number of buildings with an 'N' matches the numbers in Table 4.

Blackwater Reuse in Commercial Buildings of 250,000 Gross Square Feet (gsf) or Greater

SFPUC staff evaluated modifying the ordinance to require commercial buildings to reuse blackwater for toilet and urinal flushing to achieve additional potable water savings. Currently, the ordinance requires projects to capture available graywater, rainwater, and foundation drainage. Blackwater can be treated and reused on a voluntary basis. Analysis has shown that blackwater reuse in a commercial office building can offset 100% of the building's toilet and urinal flushing demands, which can represent up to 75% of the building's total indoor potable water demands. This increased water savings is substantial when compared to commercial buildings reusing graywater onsite, which can offset only about 15% of total building indoor potable water demands. Additionally, SFDPH's regulations for onsite water reuse systems contain water quality requirements for the treatment and reuse of blackwater that would result in water quality that is protective of public health. Furthermore, the SFPUC's Headquarters building serves as a successful example of a blackwater treatment system in operation in a commercial setting.

Table 1. Considerations for requiring blackwater reuse in commercial buildings of 250,000 gsf or greater

Pros	Cons
<ul style="list-style-type: none"> • Reusing blackwater in an office building can offset 100% of toilet and urinal flushing demands, which can represent up to 75% of a building's total indoor potable water demands. • Increasing potable water offsets from new development projects can help build the resilience of the City's water supply. • In combined sewer areas, development projects that reuse 	<ul style="list-style-type: none"> • Commercial buildings reusing graywater onsite can offset only about 15% of total building indoor potable water demands.

blackwater onsite can benefit the sewer system by diverting wastewater flows away from the sewer during storm events.	
---	--

Graywater Reuse for Toilet and Urinal Flushing, Clothes Washing, and Irrigation in Multi-Family and Mixed-Use Residential Buildings of 250,000 Gross Square Feet or Greater

SFPUC staff also evaluated modifying the ordinance to require multi-family and mixed-use residential buildings to reuse graywater to meet clothes washing as an end use, going beyond the current requirement for only toilet and urinal flushing and irrigation demands to be met. Analysis has shown that toilet and urinal flushing demands account for about 15% of total indoor water use in multi-family and mixed-use residential buildings. By reusing graywater to also meet clothes washing demands, these buildings can increase their potable water offset by an additional 15%, which can result in up to 30% offset of the building’s total indoor potable water use, thereby maximizing the potential potable water offsets of an onsite water reuse system. Multi-family and mixed-use residential buildings often produce ample graywater, therefore it’s not necessary to reuse blackwater to meet their non-potable water demands. Analysis has also shown that adding clothes washing as an end use would require a minor amount of additional plumbing. Additionally, SFDPH’s regulations for onsite water reuse systems contain water quality requirements for the treatment and reuse of graywater that would result in a water quality for clothes washing that is protective of public health.

Table 2. Considerations for requiring graywater reuse for toilet and urinal flushing, clothes washing, and irrigation in multi-family and mixed-use residential buildings of 250,000 gsf or greater

<u>Pros</u>	<u>Cons</u>
<ul style="list-style-type: none"> • Toilet and urinal flushing demands account for about 15% of total indoor water use in multi-family and mixed-use residential buildings. By reusing graywater to also meet clothes washing demands, these buildings can increase their potable water offset by an additional 15%, which can result in up to 30% offset of the building’s total indoor potable water use, thereby maximizing the potential potable water offsets of an onsite water reuse 	<ul style="list-style-type: none"> • Additional public education and outreach may be needed to encourage the safety and benefits of using graywater for clothes washing.

District-Scale Water Reuse Systems

Additionally, SFPUC staff analyzed modifying the ordinance to require development projects with more than one building to install a district-scale water reuse system. The modification would be applicable to development projects with a cumulative square footage of 250,000 gsf or greater, which could consist of multiple buildings that may be below 250,000 gsf individually. This requirement is consistent with the current ordinance and would not result in additional development projects being subject to the ordinance. Instead of development projects installing building-by-building graywater systems, the proposed modification would require development projects with more than one building to install a district-scale water reuse system. District-scale systems benefit from economies of scale compared to many individual building treatment systems, resulting in significantly lower capital costs, lower total energy consumption, and lower total footprint of treatment and storage equipment. A large development project in San Francisco has shown it could save over \$10 million if a district-scale system was installed compared to individual building treatment systems. Furthermore, reducing the number of onsite water systems by requiring district-scale systems means that operators can spend more time ensuring the systems are working reliably. Any potential impacts on plumbing are site specific and dependent on the combination of commercial, residential, and mixed-use buildings.

Table 3. Considerations for requiring district-scale water reuse systems in development projects with more than one building

Pros	Cons
<ul style="list-style-type: none"> • District-scale systems benefit significantly from economies of scale compared to individual building-by-building systems. • A large development project in San Francisco has shown it could save over \$10 million if a district-scale system was installed compared to individual building treatment systems. • Qualified operators of onsite water reuse systems are a limited resource in San Francisco. Reducing the number of onsite systems by requiring district-scale systems may result in operators being able to spend more time ensuring treatment 	<ul style="list-style-type: none"> • District-scale systems require ownership and legal agreements among property owners. For example, establishing or designating one entity to be responsible for compliance with the Non-potable Ordinance may be challenging if there are multiple property owners. • District-scale systems require a higher initial capital investment. • The development project will have to balance the timing of construction of the district-scale system and the overall development project’s phasing.

Additional Alternate Water Sources and Non-potable End Uses

In an effort to evaluate the expansion of onsite water reuse systems, SFPUC staff considered expanding the required alternate water sources to include condensate and expanding the required non-potable end uses to include drain trap priming. Condensate is defined as water vapor that is converted to a liquid and collected, the most common source in buildings being equipment for air conditioning, refrigeration, and steam heating. A trap primer is a plumbing device or valve that adds water to traps. Per SFPUC's Rules and Regulations Regarding the Operation of Alternate Water Source Systems, non-potable water is suitable for drain trap priming. It was determined that these expansions are unlikely to result in significant cost impacts on development projects due to minimal additional infrastructure and treatment needed to add these alternate water sources and non-potable end uses to a system. These expansions may result in a small increase in potable water offsets.

SFPUC staff also considered requiring cooling tower make-up water as a non-potable use and do not recommend making this change. While cooling tower make-up water is currently allowed, it is likely to push designers toward reverse osmosis (RO) because that is currently the most reliable treatment to achieve the necessary water quality for cooling tower make-up. Because of the 75% recovery of RO systems, onsite water reuse systems may not achieve a significant additional potable offset beyond what is achieved with toilet flushing. Furthermore, requiring cooling as an end use may have significant cost impacts to a development project due to the need for a larger system size, additional treatment (i.e. RO), and the energy for operating an RO system that may be required.

Lowering the Square Footage Threshold for Compliance with the Non-potable Ordinance

As mentioned above, since 2015, new development projects of 250,000 gsf or more are required to install and operate an onsite water reuse system. It is estimated that by 2040, the development projects that are required to comply with the Non-potable Ordinance will offset approximately 1.1 mgd of potable water. When also factoring in the potable water savings from development projects voluntarily installing onsite water reuse systems, the total potable water offset increases to 1.3 mgd by 2040.

SFPUC staff analyzed the impact of lowering the 250,000 gsf threshold to 100,000 gsf. In this analysis, SFPUC also considered a volume-based threshold; however it was determined that using a single square footage threshold creates the simplest and most streamlined way for development projects to understand if they are required to comply with the ordinance.

To understand the number of planned multi-family, mixed-use, and commercial development projects that would be impacted by the potential amendments and anticipated potable water offsets, SFPUC staff reviewed the San Francisco Planning Department's Pipeline Report published with 2020 Quarter 1 data and internal databases used for tracking future developments' compliance with the ordinance. SFPUC staff, in consultation with other city agencies, determined that the most streamlined way to apply future potential amendments was to make them applicable to only planned development projects that have not yet filed a site permit. Therefore, SFPUC staff analyzed only planned development projects that have not yet filed for a site permit. Appendix A contains more information on these developments and Table 4 summarizes the number of future development projects and anticipated potable water offsets if the square footage threshold were lowered to 100,000 gsf. In Appendix A, any building marked with a Y in the 'Site Permit Filed or Issued' column was not included in the potable offset analysis for the above stated reason. The buildings with an 'N' were included, and the total number of buildings with an 'N' matches the numbers in Table 4. Table 4 shows that if the threshold were lowered to 100,000 gsf, approximately 0.02 mgd of additional potable water savings could be achieved. This constitutes only 2% of the total water savings estimated for developments projects that are required to comply with the Non-potable Ordinance.

SFPUC staff also compared other potential impacts on factors such as cost and footprint to development projects under the existing 250,000 gsf threshold. Onsite water reuse systems benefit from economies of scale for both cost and footprint, and these factors do not scale on a 1:1 basis. The footprint needed for an onsite water reuse system in a smaller building would be smaller, but the ratio of system size to total building size likely goes up, meaning the system takes up a larger percentage of total building space. Similarly, the cost of a system in a smaller building would also be smaller, but again not on a 1:1 basis. For example, a major technology supplier in San Francisco indicated that the cost of a graywater treatment system would only be 15% different between a 250,000 gsf and 100,000 gsf building. Additionally, there are other costs associated with onsite water reuse systems that are more fixed, such as operations, maintenance, and water quality sampling. A smaller treatment system will still need a qualified operator and the same number of water quality samples as a larger system of the same type; therefore the fixed costs wouldn't be substantially less for smaller buildings. Although smaller buildings with onsite water reuse systems may have reduced water and sewer bills, they would face a relatively higher capital and operations and maintenance cost than larger buildings. There is not sufficient data at this time to say conclusively whether this would be a net benefit or cost to smaller buildings.

Some smaller buildings lower than 250,000 gsf will be required to comply with the Non-potable Ordinance if the individual buildings are part of a larger development project. In this case, these buildings can leverage the economies of scale of onsite reuse by connecting to a district-scale system serving the whole development.

Table 4. Estimated potable water offsets from multi-family, mixed-use, and commercial development projects required to comply with the NPO (i.e. >250,000 gsf) and from future development projects 100,000 gsf or greater

Size Range (gross square feet)	Number of Development Projects¹	Estimated Potable Water Offsets in mgd²
≥ 250,000	50	1.1 mgd
200,000 – 250,000	0	0 mgd
150,000 – 200,000	2	0.003 mgd
100,000 – 150,000	5	0.012 mgd

¹ *Estimates of future development projects between 100,000 and 250,000 gsf taken from San Francisco Planning Department’s Pipeline 2020 Q1 Report and SFPUC tracking databases.*

² *Potable offsets estimated using information provided by projects such as water budget applications, where available. For future projects, staff used the SFPUC Water Use Calculator to estimate future offsets.*

In summary, the Non-potable Ordinance amendments discussed above are estimated to achieve an additional potable water savings of approximately 0.2 mgd. The water savings of 0.2 mgd is equivalent to about 5,500 San Francisco residents daily water use. A breakdown of the estimated water savings can be found in Table 5 below.

Table 5. Additional Potable Water Savings Resulting from the Non-potable Ordinance Amendments

	Potable water savings by requiring blackwater reuse in commercial buildings (mgd)	Potable water savings by requiring graywater reuse for clothes washing in multi-family and mixed-used residential buildings (mgd)	Total potable water savings (mgd)
New development projects over 250,000 gross square foot (gsf) threshold	0.04	0.14	0.18
New development projects between 100,000 gsf and 250,000 gsf	0.001	0.014	0.02

Table 6. Considerations for requiring new development projects 100,000 gsf or greater to comply with the Non-potable Ordinance

<u>Pros</u>	<u>Cons</u>
<ul style="list-style-type: none"> • There is not a significant potable water offset that could be achieved by requiring new development projects below 250,000 gsf to comply with the ordinance. 	<ul style="list-style-type: none"> • Minimal additional potable water savings could be achieved by requiring smaller buildings to comply with the ordinance. If the square footage threshold for compliance were lowered to 100,000 gsf, this would only realize an additional 0.02 mgd of potable water savings, representing just 2% of the total savings anticipated for the developments projects that are required to comply with the Non-potable Ordinance by 2040. • Compared to a 250,000 gsf building, the relative capital cost that a smaller building would face would be larger. For example, according to a major technology supplier in San Francisco, a graywater treatment system in a 100,000 gsf building would cost only 15% less than that for a 250,000 gsf building. • The ongoing operations and maintenance costs and water quality sampling costs are largely fixed for onsite treatment systems, and wouldn't be substantially less for smaller buildings.

Recommendations for Potential Non-potable Ordinance Amendments

- It is recommended to require commercial buildings to reuse blackwater to meet toilet and urinal flushing demands. Commercial buildings reusing blackwater can offset more potable water use as compared to graywater. For example, a commercial office building can offset 100% of toilet flushing demands with blackwater reuse compared to graywater reuse which can only offset about 20% of toilet flushing demands.
- It is recommended to require multi-family and mixed-use residential buildings to reuse graywater to meet toilet and urinal flushing, clothes washing, and irrigation demands. Residential buildings produce an excess of graywater and can achieve additional potable water savings by

going beyond the current requirement for only toilet and urinal flushing and irrigation demands to be met by adding clothes washing as an additional required end use.

- It is recommended to require new developments with more than one building to install a district-scale reuse system. District-scale water reuse systems have additional benefits compared to individual building treatment systems, as economies of scale can result in significantly lower capital costs, lower total energy consumption, and lower total footprint of treatment and storage equipment.
- To incorporate condensate and drain trap priming is a policy decision for the Board of Supervisors.
- To lower the threshold to 100,000 gsf is a policy decision for the Board of Supervisors.

5. Wastewater Heat Recovery Systems: Evaluating Implementation in San Francisco

Wastewater heat recovery refers to the extraction of thermal energy from warm wastewater, and subsequent beneficial use of this energy to offset existing energy requirements. Common components of wastewater heat recovery systems include:

- **Wet Well or Equalization Tank:** a tank used to collect raw wastewater upstream of a wastewater heat recovery system for the purpose of supplying a consistent flow.
- **Solid-Liquid Separation:** an initial process step whereby solids are removed from the liquid portion of the wastewater prior to the liquid being sent to the heat exchanger and/or heat pump.
- **Heat Exchanger:** a device for passively transferring heat between two or more fluids. The fluids may be separated by a solid wall to prevent mixing or they may be in direct contact. In a heat exchanger, heat will move spontaneously from the hotter fluid into the colder fluid.
- **Heat Pump:** a device that actively transfers heat from a colder fluid to a hotter fluid, i.e. in the opposite direction of spontaneous heat transfer. In a heat pump, an additional energy source is needed to facilitate the heat transfer. Heat pump efficiency is defined by a coefficient of performance (COP), which describes the ratio of energy recovered to external energy used. Generally, a COP above 3 is deemed fairly efficient.

Implementation Scales for Wastewater Heat Recovery Systems

In a single-family home application, graywater (also referred to as drain-water heat exchangers) recover heat from hot water used in showers, bathtubs, sinks, dishwashers, and clothes washers. They then typically store the recovered heat so it can be used to heat future home water needs. Drain-water heat recovery

systems usually have a copper heat exchanger that replaces a vertical section of a main waste drain. As warm water flows down the waste drain, incoming cold water flows through a spiral copper tube wrapped tightly around the copper section of the waste drain. This preheats the incoming cold water that goes to the water heater or a fixture, such as a shower.

By preheating cold water, drain-water heat recovery systems help increase water heating capacity. This increased capacity may be of particular value in homes with undersized water heater. They also allow homes to lower their water heating temperature without affecting water heating capacity. From an economic standpoint, these systems offer a payback period of 3-7 years, depending on how often the system is used (Department of Energy).

At the individual, larger building scale, wastewater heat recovery systems could be configured as shown below in Figure 1. The heat recovered from a building's wastewater (blackwater or graywater) can be directly used for domestic hot water heating or space heating and/or cooling.

Alternatively, district scale wastewater heat recovery systems can provide domestic water heating, space heating, and space cooling to entire neighborhoods. The district-scale model is based around a centralized treatment facility, which acts as the energy and wastewater hub for a community and distinguishes district-scale systems from those installed in individual buildings. Incorporating wastewater heat recovery into district-scale water reuse system would require projects to include a district energy system that could be used to distribute the recovered heat to individual buildings. This would introduce a significant level of complexity, requiring a central energy plant, as well as additional infrastructure in the streets and likely in each building. The False Creek Energy Center in Vancouver is a prime example and more details can be found in Appendix B.

Wastewater Heat Recovery Benefits and Onsite Water Reuse Synergies

Wastewater heat recovery systems have the potential to significantly offset the energy consumption of onsite water reuse systems. In fact, integrating wastewater heat recovery with onsite water reuse offers several synergies:

- Tanks that collect raw wastewater for onsite water recycling can be leveraged for wastewater heat recovery. Onsite water reuse systems will already have such tanks available to provide a consistent flow to the wastewater heat recovery system.
- Using raw wastewater in a wastewater heat recovery system can present challenges for the equipment because of solids, oils, grease, hair, and other constituents; using treated blackwater or graywater from an onsite water reuse system as the heat source can enable heat recovery from a much cleaner stream.
- Wastewater heat recovery systems cool down the treated water being sent

to buildings for applications such as toilet flushing and cooling towers. Cooling down the treated water has several benefits, including improved efficiency in cooling towers and improved control of *Legionella* growth in premise plumbing.

Wastewater heat recovery systems can be integrated with onsite water reuse systems in multiple configurations. Two examples of potential integration are illustrated in Figure 1. In both examples, the heat is recovered from the treated blackwater or graywater storage tank and used in the domestic hot water heating system. In the top configuration, ‘Hot Water Boiler Pre-Heating,’ the recovered heat is used to pre-heat potable water that is then sent through a hot water boiler. In the bottom scenario, ‘Hot Water Tank Temperature Control,’ the recovered heat is used to maintain the temperature of water that has already been heated and is being stored in a hot water storage tank.

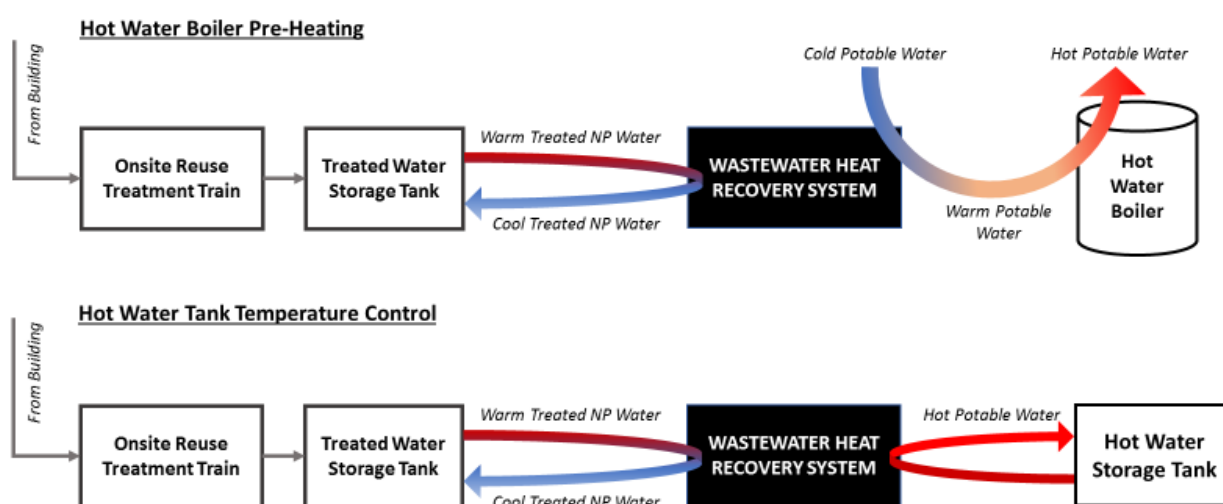


Figure 1. Example configurations for integration of wastewater heat recovery and onsite water reuse systems.

Types of Wastewater Heat Recovery Technology

Companies offer packaged wastewater heat recovery systems that can be compact and self-contained. For example, SHARC Energy Systems Inc. offers the Piranha packaged system, which is intended for use in buildings with 50 – 200 units (International Wastewater Systems, 2014). The system is designed to provide hot water heating or pre-heating. Another packaged system offering is the HUBER RoWin system, which can be used at the building scale. The system would integrate with a building’s domestic hot water system or could be coupled to the HVAC system (HUBER Technology, 2018). In general, these types of systems experience the highest efficiency when the wastewater storage tank, the heat exchanger, and the hot water boiler are located in close proximity to one another.

Current Status of Wastewater Heat Recovery in San Francisco

In an effort to consider ways to reduce energy footprint of onsite water reuse systems, SFPUC updated its existing Onsite Water Reuse Grant Program in 2019 to incentivize the implementation of wastewater heat recovery systems within development projects installing onsite water reuse systems. The grant program requires all projects applying for a grant to estimate the potential energy offset that can be achieved with wastewater heat recovery. In addition, mixed-used and multi-family buildings that are grant recipients are required to implement wastewater heat recovery. Research shows that multi-family and mixed-use buildings present the best opportunity for wastewater heat recovery because they are most likely to have centralized hot water boilers. There can be a significant volume of graywater and thus more energy to recover via wastewater heat recovery. Commercial buildings are not optimal for the installation of wastewater heat recovery because they do not tend to have centralized hot water boilers, and so using the heat recovered from wastewater becomes more challenging.

SFPUC's goal in integrating wastewater heat recovery into the grant program is to gather more information about the potential benefits of these systems and understand how implementation could occur successfully in San Francisco.

More broadly, decentralized wastewater heat recovery systems implemented at the building or district scale are very limited in the U.S. Based on research and interviews with SFPUC staff and consultants, while wastewater heat recovery has been piloted at a few wastewater treatment plants in the U.S., these systems have been implemented as demonstration projects and haven't resulted in any formal regulatory processes being developed.

Energy Savings and Emissions Reduction from Wastewater Heat Recovery

The emissions reduction associated with wastewater heat recovery technology is dependent on the nature of the energy sources powering the relevant grid. A recent study conducted life cycle assessments of onsite water reuse systems with associated wastewater heat recovery systems; the findings in terms of global warming potential depended on the underlying energy sources (Arden et al., 2020). If buildings are fully powered by electricity, then wastewater heat recovery systems will result in a reduction in electricity usage. The resultant benefit in terms of emissions depends on the extent to which the electric grid relies on fossil fuels. For buildings powered entirely by renewables, as many are in San Francisco, there would be no net benefit to the building in terms of greenhouse gas emissions reduction. Additionally, there is typically a tradeoff between energy recovery and system efficiency. Recovering higher amounts of heat will require a higher input of energy via the heat pump, and thus the efficiency will go down.

The following example provides context for the potential energy savings that

could be achieved in a multi-family residential building, based on the following assumptions:

- Assumed graywater as source water, as is required by the NPO
- Assumed 15 gpy/sf of graywater generation for primarily residential buildings, based on SFPUC's Water Use Calculator
- Assumed a 15°F drop in graywater temperature through the heat recovery system

Under these conditions, a theoretical 250,000 square foot residential building could recover 300 kWh/day using wastewater heat recovery. This type of building is likely to use in total somewhere in the range of 10,000 kWh/day (Energy Star Portfolio Manager, 2018). Although the recovered energy is a small percentage of the overall building energy demand, it is likely to be a significant portion of the energy used for onsite water reuse treatment.

Table 7. Summary of considerations for installing wastewater heat recovery systems in conjunction with an onsite water reuse system in San Francisco

<u>Pros</u>	<u>Cons</u>
<ul style="list-style-type: none"> • Wastewater heat recovery has the potential to lower the energy use associated with onsite water reuse treatment. The biggest opportunity is in multi-family residential and mixed-used buildings. • Wastewater heat recovery and onsite water reuse can have synergies when installed together, such as shared infrastructure. 	<ul style="list-style-type: none"> • Adding wastewater heat recovery to a building will add cost and take up building footprint. • Including wastewater heat recovery in a district-scale system can be highly complex, as it would require a district energy system to recover and distribute the energy. • There are limited examples of the technology being successfully installed and operated in the United States. Therefore, SFPUC is incentivizing the voluntary installation of these systems to gather additional information.

Recommendations for Wastewater Heat Recovery Systems

- The best opportunity to install a drain-heat recovery system in a single-family home application would be during new construction or a major renovation, although this is a minimal market since there are limited single family home development opportunities in San Francisco. Application of this technology in existing homes would

most likely be limited due to technical challenges around physical space constraints. It is not recommended to require installation of drain-heat recovery systems in new San Francisco single-family homes.

- It is recommended for the SFPUC to continue to encourage wastewater heat recovery systems in larger individual buildings with onsite water reuse systems and at the district-scale via the Onsite Water Reuse Grant Program because wastewater heat recovery systems have the potential to significantly offset the energy consumption of onsite water reuse systems. Voluntary use of the technology will allow staff to gather more information about the potential benefits and implementation.

6. Solar Thermal Water Heating Systems: Evaluating Implementation in San Francisco

Solar thermal technology is a well-established means of heating domestic hot water. Over the last 40 years the technology has been refined and improved upon. Today's solar thermal products follow established codes, certifications (Solar Rating and Certification Corporation (SRCC)), and make use of modern engineering practices.

For the purposes of this document, Flat Plate Collector (FPC) and Evacuated Tube collectors are considered. These two technologies are commercially available, have proven track records, and meet commercial and residential water heating needs. FPC and Evacuated Tube collectors rely on standard solar principles such as good sun exposure and southern orientation. These collectors are manufactured in various sizes; 4' x 10' is a common size for commercial installations. Both collector types are comprised of copper tubing (which contains the fluid that is heated by the sun) inside an insulated glass enclosure. These systems are very modular; collectors can be added together in groups to increase the system size depending on the energy production requirements for a given site. These characteristics make FPC and Evacuated Tube collectors ideal for roof top installations.

In San Francisco's climate, FPC and Evacuated Tube collectors are capable of heating water to 140 degrees Fahrenheit. Using industry standards, an estimate can be made of the energy production of a solar thermal system in San Francisco. A FPC and Evacuated Tube collector will generate about 1,000 BTU's per square foot of collector on a sunny day (850-1,000 watts/meter squared). Therefore, a standard sized 4' x 10' collector will produce about 40,000 BTU/day (which is equivalent to 12 kWh).

Pricing for commercial systems is based on a price per square foot of collector.¹ In San Francisco, prices range from \$190 to \$250 per square foot of collector, depending on site conditions and project complexity. For example, in 2020, a commercial solar thermal system (with 16 collectors) was installed at a low-income multifamily housing development. The total project cost was \$152,885, or \$237 per square foot of installed collector. The cost of a fully installed residential system in San Francisco is typically between \$6,500 and \$14,000.

System sizing and cost savings can be calculated based on the energy needs of a business or residence and current utility rates. There are several online calculation tools that are free to users. Links to two examples are shown below.

- https://www.eere.energy.gov/femp/solar_hotwater_system/
- <http://www.freehotwater.com/solar-calculators/solar-thermal-calculator/>

Below are some considerations for San Francisco businesses to factor into their evaluation process when looking into FPC and Evacuated Tube solar thermal systems.

Table 8. Considerations for evaluating solar thermal systems in San Francisco

Pros	Cons
<ul style="list-style-type: none"> • Solar thermal systems are very well suited for rooftop installation. • These systems generate high temperatures making them viable for many commercial and residential needs. • The products have a proven track record and are commercially available. • Energy production can be estimated with a high degree of certainty allowing businesses and home owners to better understand what their investment can do to reduce energy demand and increase savings. 	<ul style="list-style-type: none"> • Solar thermal systems are affected by fog, so locations on the east side of San Francisco will be better suited for this technology. • Solar professionals that are qualified to work on solar thermal systems are limited in the Bay Area. Finding the right company to do the installation will take some research. • Solar Thermal systems will not eliminate 100% of the annual domestic hot water heating needs. These systems need a backup source of energy in times of the year when there is not enough sun to cover the water heating needs. • The proposed site for a solar thermal installation should have minimal shading and a southern

¹ Financial information in this section is based on a review of California Solar Thermal Statistics as reported by the California Solar Initiative (CSI)-Thermal Program. Data can be found at <http://www.csithermalstats.org/>

Recommendations for Solar Thermal Systems

- Residential properties and commercial businesses that use a lot of hot water in their operations should consider a solar thermal installation. With the high temperatures that can be achieved, the systems can offer value to a wide range of businesses, particularly hotels, restaurants, and laundromats.

7. On-Demand Hot Water Heaters

In FY 2021-2022, the SFPUC proposes to launch a pilot program to rebate a portion off the purchase price of installed on-demand recirculating hot water heater pumps and to evaluate their water-savings potential. Manufacturers claim that such pumps can save water by reducing the amount of time customers, particularly in older homes, have to wait for hot water to hit showers and taps. When the pump is activated, it begins recirculating cold water that has been sitting in the hot water line and sends it back to the water heater through the cold water line. When the water reaches a desired temperature, a control turns the pump off. This process is similar to turning on the shower and letting the water run until it gets hot, but instead of the water going down the drain, it is returned back to the water heater. The target market for the pilot rebate program and study is residential single-family and small multi-family properties in which each dwelling unit has its own hot water tank. Multi-family properties with central hot water boilers that serve all dwelling units would not qualify. Other site conditions would also have to be met.

8. Summary of Recommendations

SFPUC staff have identified the following recommendations for the modifications of the Non-potable Ordinance in order to increase potable water savings from new buildings and development projects and increase opportunities for cost-effective systems:

- It is recommended to require commercial buildings to reuse blackwater to meet toilet and urinal flushing demands. Commercial buildings reusing blackwater can offset more potable water use as compared to graywater. For example, a commercial office building can offset 100% of toilet flushing demands with blackwater reuse compared to graywater reuse which can only offset about 20% of toilet flushing demands.
- It is recommended to require multi-family and mixed-use residential buildings to reuse graywater to meet toilet and urinal flushing, clothes washing, and irrigation demands. Residential buildings produce an excess of graywater and can achieve additional potable water savings by

going beyond the current requirement for only toilet and urinal flushing and irrigation demands to be met by adding clothes washing as an additional required end use.

- It is recommended to require new developments with more than one building to install a district-scale reuse system. District-scale water reuse systems have additional benefits compared to individual building treatment systems, as economies of scale can result in significantly lower capital costs, lower total energy consumption, and lower total footprint of treatment and storage equipment.
- To incorporate condensate and drain trap priming is a policy decision for the Board of Supervisors.
- To lower the threshold to 100,000 gsf is a policy decision for the Board of Supervisors.

SFPUC staff have identified the following recommendations pertaining to wastewater heat recovery systems:

- The best opportunity to install a drain-heat recovery system in a single-family home application would be during new construction or a major renovation, although this is a minimal market since there are limited single family home development opportunities in San Francisco. Application of this technology in existing homes would most likely be limited due to technical challenges around physical space constraints. It is not recommended to require installation of drain-heat recovery systems in new San Francisco single-family homes.
- It is recommended for the SFPUC to continue to encourage wastewater heat recovery systems in larger individual buildings with onsite water reuse systems and at the district-scale via the Onsite Water Reuse Grant Program because wastewater heat recovery systems have the potential to significantly offset the energy consumption of onsite water reuse systems. Voluntary use of the technology will allow staff to gather more information about the potential benefits and implementation.

SFPUC staff have identified the following recommendations pertaining to solar thermal systems:

- Residential properties and commercial businesses that use a lot of hot water in their operations should consider a solar thermal installation. With the high temperatures that can be achieved, the systems can offer value to a wide range of businesses, particularly hotels, restaurants, and laundromats.

References:

Arden, S., B. Morelli, S. Cashman, X.C. Ma, M. Jahne, J. Garland. (2020) Onsite Non-Potable Reuse for Large Buildings: Environmental and Economic Sustainability as a Function of Building Characteristics and Location. *Water Research*, not yet published.

Carmichael, J., and Y. Suda. (2015) "Heat-Seeking Sewer Model: Finding Waste Heat in Sewers and Matching It to Opportunities." *District Energy*: 2015 4th Quarter, 29-33.

Dodge, D., and D. Kinney. (2014). "Waste Heat: How Vancouver Mined Its Sewage to Heat an Entire Neighborhood." *Green Energy Futures*.

Energy Star Portfolio Manager. (2018) *U.S. Energy Use Intensity by Property Type*.

HUBER Technology. (2018) *Heat Recovery from Wastewater HUBER ThermWin*. HUBER Technology. *Heating and Cooling With Wastewater*.

International Wastewater Systems. (2014) *Sewage SHARC S-660 Data Sheet*.

Kaufman, Rachel. (2012) "Waste Wattage: Cities Aim to Flush Heat Energy Out of Sewers." *National Geographic News* 11 December 2012.

Natural Systems Utilities. (2019) *NSU Thermal Energy Recovery, Water/Energy Nexus*.

U.S. Department of Energy. (2020) *Drain-Water Heat Recovery*.

Appendix A: Site Permit Status of Future Developments in San Francisco Between 250,000 and 100,000 Gross Square Feet

To understand the number of planned multi-family, mixed-use, and commercial development projects that would be impacted and anticipated potable water offsets, SFPUC staff reviewed the San Francisco Planning Department’s Pipeline Report published with 2020 Quarter 1 data and internal databases used for tracking future developments’ compliance with the ordinance. SFPUC staff, in consultation with other city agencies, determined that the most streamlined way to apply future potential amendments was to make them applicable to only planned development projects that have not yet filed a site permit. Therefore, SFPUC staff analyzed only planned development projects that have not yet filed for a site permit. Appendix A contains more information on these developments and Table 4 summarizes the number of future development projects and anticipated potable water offsets if the square footage threshold were lowered to 100,000 gsf. In Appendix A, any building marked with a Y in the ‘Site Permit Filed or Issued’ column was not included in the potable offset analysis for the above stated reason. The buildings with an ‘N’ were included, and the total number of buildings with an ‘N’ matches the numbers in Table 4.

Address	Type	Sq Ft	Site Permit Filed or Issued
145 Hooper St, 188 Hooper St	Residential	243,330	Y
625 Gilman	Residential	234,887	Y
2500-2698 Turk	Residential	234,450	Y
950 - 974 MARKET ST	Mixed-Use Residential	230,100	Y
1401 Illinois	Mixed-Use	228,869	Y
1401 - 1443, 1499 Illinois St	Mixed-Use	228,869	Y
1601 Mission	Residential	225,000	Y
555 HOWARD STREET	Mixed-Use Residential	210,906	Y
2201 Bay Shore Blvd	Residential	210,000	Y
MISSION BAY BLOCK 1 (VISITOR)	Hotel	207,000	Y
1550 Evans	Community Facility	203,775	Y
565 BRYANT ST	Hotel	193,045	N
600 Van Ness	Mixed-Use Residential	185,739	Y

Address	Type	Sq Ft	Site Permit Filed or Issued
302 silver	Residential	180,000	Y
1028 Market	Mixed-Use	178,308	Y
1064-1068 Mission	Residential	177,000	Y
1850 BRYANT ST	Office	175,333	Y
1995 Evans	Office	175,150	Y
2060 Folsom	Mixed-Use	165,350	Y
525 Harrison	Mixed-Use Residential	159,302	Y
1351 42nd Ave	Residential	159,000	Y
1990 Folsom	Residential	156,800	Y
1140 Folsom/99 Rausch St	Residential	153,675	Y
2130 3rd St	UCSF Child, Teen, Family Center and UCSF Dept of Psychiatry Building	150,000	N
1532 Harrison St	Mixed-Use Residential	144,487	Y
333 12th St	Residential	144,000	Y
150 HOOPER ST	Mixed-Use	142,784	Y
325 Fremont	Mixed-Use Residential	142,465	Y
1125 MARKET ST	Mixed-Use	139,852	Y
SEAWALL LOTS 323 & 324	Hotel	138,800	N
1546-1564 Market St	Mixed-Use Residential	138,000	N
1200 VAN NESS AV	Mixed-Use Residential	137,749	Y
360 5th Street	Mixed-Use Residential	132,560	Y
552 BERRY ST / 1 DE HARO ST	Mixed-Use	129,619	N
210 Taylor St	Mixed-Use	129,526	Y
2675 Folsom	Residential	127,082	Y
570 MARKET ST	Hotel	126,824	N
950 Gough	Mixed-Use Residential	125,000	Y
58 Kirkwood Ave	Residential	118,886	N
2800 Sloat	Residential	117,000	Y
1830 Alemany Blvd	Mixed-Use Residential	115,610	Y

Address	Type	Sq Ft	Site Permit Filed or Issued
424 Brannan ST	Hotel	105,989	Y

Appendix B: Wastewater Heat Recovery Case Studies

Solaire Building, Battery Park – Coupled Onsite Water Reuse and Wastewater Heat Recovery System

The Solaire building is a 27-story residential tower with 293 units located in New York City. Since 2003, Solaire has been operating an onsite blackwater treatment system that collects and treats 100 percent of the building's wastewater for use in toilet flushing, irrigation, and cooling. In 2017, Natural Systems Utilities retrofitted the system, adding a wastewater heat recovery system that transfers heat from the treated blackwater to the building's hot water boiler.

The heat recovery system consists of a heat pump and heat exchanger that serves to pre-heat water going to the building's hot water boiler. The heat source is the treated and disinfected wastewater, which exits the treatment train at about 75 °F, and drops to 55 °F after the heat recovery system. The heat recovery unit itself is smaller than a refrigerator, and the total cost of the retrofit was in the range of \$100,000 - \$150,000. The system has a capacity of 150,000 BTU/hr, or 44 kW, and operates at just under half of that capacity. The system can recover about 400 kWh/day, which is more than the energy consumption of the onsite reuse treatment train (~300 - 350 kWh/day), giving the onsite reuse system a net zero energy balance. Approximately 30% of water heating demands are offset by the wastewater heat recovery system.

The False Creek Neighborhood Energy Utility Wastewater Heat Recovery System

The False Creek Neighborhood Energy Utility (NEU) in Vancouver, Canada is a district-scale wastewater heat recovery system, the first of its kind in North America. The development contains multi-family residential, commercial, and community buildings and covers an area of over 4.2 million square feet. The NEU was implemented through a joint effort by the City of Vancouver and Metro Vancouver, the region's water and wastewater utility. The project cost roughly \$31 million to construct and was financed by the city through a combination of city funds and government loans.

The NEU distributes heat to 27 buildings and over 4,000 residential suites within the South East False Creek development, meeting about 70% of the total heating demand for the community. The NEU contains a 3.2 MW wastewater heat recovery unit and 16 MW natural gas peaking boilers for backup. The system uses both heat pumps and heat exchangers to recover thermal energy from untreated wastewater and transfer it to distribution water. This heated water is then sent to buildings, each of which contains an energy transfer station that transfers the thermal energy from the heated water to the building's mechanical system, which then distributes heat and hot water to

building occupants. The energy transfer stations also meter the building's energy production and consumption for billing.

BOARD of SUPERVISORS



City Hall
1 Dr. Carlton B. Goodlett Place, Room 244
San Francisco 94102-4689
Tel. No. (415) 554-5184
Fax No. (415) 554-5163
TDD/TTY No. (415) 554-5227

July 2, 2021

File No. 210536

Lisa Gibson
Environmental Review Officer
Planning Department
49 South Van Ness Ave, Suite 1400
San Francisco, CA 94103

Dear Ms. Gibson:

On June 29, 2021, Supervisor Mandelman introduced the following legislation as a substitute:

[Health, Business and Tax Regulations Codes - Alternate Water Sources for Non-Potable Applications]

Ordinance amending the Health Code to 1) lower the threshold, from 250,000 to 100,000 square feet of gross floor area, for requiring that new buildings be constructed, operated, and maintained using specified alternate water sources for required non-potable uses; 2) exempt certain affordable housing projects and property uses from that requirement; 3) require that certain categories of new buildings use specific sources of nonpotable water for specific purposes; 4) modify certain administrative review fees; 5) require the payment of excess use charges and penalties for failure to properly use and maintain alternate water source systems; and 6) the completion of reports on purified water, recycled water, and Non-potable District Systems; amending the Business and Tax Regulations Code to update certain annual license fee amounts for operating alternate water source systems; and affirming the Planning Department's determination under the California Environmental Quality Act.

This legislation is being transmitted to you for environmental review.

Angela Calvillo, Clerk of the Board
By: John Carroll, Assistant Clerk
Public Safety and Neighborhood Services Committee

Attachment

c: Devyani Jain, Deputy Environmental Review Officer
Joy Navarrete, Environmental Planner
Don Lewis, Environmental Planner

Not defined as a project under CEQA Guidelines Sections 15378 and 15060(c)(2) because it would not result in a direct or indirect physical change in the environment.

07/02/2021

Joy Navarrete

BOARD of SUPERVISORS



City Hall
1 Dr. Carlton B. Goodlett Place, Room 244
San Francisco 94102-4689
Tel. No. (415) 554-5184
Fax No. (415) 554-5163
TDD/TTY No. (415) 554-5227

July 2, 2021

File No. 210536

Lisa Gibson
Environmental Review Officer
Planning Department
49 South Van Ness Ave, Suite 1400
San Francisco, CA 94103

Dear Ms. Gibson:

On June 29, 2021, Supervisor Mandelman introduced the following legislation as a substitute:

[Health, Business and Tax Regulations Codes - Alternate Water Sources for Non-Potable Applications]

Ordinance amending the Health Code to 1) lower the threshold, from 250,000 to 100,000 square feet of gross floor area, for requiring that new buildings be constructed, operated, and maintained using specified alternate water sources for required non-potable uses; 2) exempt certain affordable housing projects and property uses from that requirement; 3) require that certain categories of new buildings use specific sources of nonpotable water for specific purposes; 4) modify certain administrative review fees; 5) require the payment of excess use charges and penalties for failure to properly use and maintain alternate water source systems; and 6) the completion of reports on purified water, recycled water, and Non-potable District Systems; amending the Business and Tax Regulations Code to update certain annual license fee amounts for operating alternate water source systems; and affirming the Planning Department's determination under the California Environmental Quality Act.

This legislation is being transmitted to you for environmental review.

Angela Calvillo, Clerk of the Board
By: John Carroll, Assistant Clerk
Public Safety and Neighborhood Services Committee

Attachment

c: Devyani Jain, Deputy Environmental Review Officer
Joy Navarrete, Environmental Planner
Don Lewis, Environmental Planner

BOARD of SUPERVISORS



City Hall
1 Dr. Carlton B. Goodlett Place, Room 244
San Francisco 94102-4689
Tel. No. (415) 554-5184
Fax No. (415) 554-5163
TDD/TTY No. (415) 554-5227

May 19, 2021

File No. 210536

Lisa Gibson
Environmental Review Officer
Planning Department
49 South Van Ness Ave, Suite 1400
San Francisco, CA 94103

Dear Ms. Gibson:

On May 11, 2021, Supervisor Mandelman introduced the following legislation:

[Health, Business and Tax Regulations Codes - Alternate Water Sources for Non-Potable Applications]

Ordinance amending the Health Code to 1) lower the threshold, from 250,000 to 100,000 square feet of gross floor area, for requiring that new buildings be constructed, operated, and maintained using specified alternate water sources for required non-potable uses; 2) exempt certain affordable housing projects and property uses from that requirement; 3) require that certain categories of new buildings use specific sources of non-potable water for specific purposes; 4) require that new developments with multiple buildings install an alternate water source system serving the entire development; 5) modify certain administrative review fees; and 6) require the payment of excess use charges and penalties for failure to properly use and maintain alternate water source systems; amending the Business and Tax Regulations Code to update certain annual license fee amounts for operating alternate water source systems; and affirming the Planning Department's determination under the California Environmental Quality Act.

This legislation is being transmitted to you for environmental review.

Angela Calvillo, Clerk of the Board
By: John Carroll, Assistant Clerk
Public Safety and Neighborhood Services Committee

Attachment

c: Devyani Jain, Deputy Environmental Review Officer
Joy Navarrete, Environmental Planner
Don Lewis, Environmental Planner

BOARD of SUPERVISORS



City Hall
1 Dr. Carlton B. Goodlett Place, Room 244
San Francisco 94102-4689
Tel. No. (415) 554-5184
Fax No. (415) 554-5163
TDD/TTY No. (415) 554-5227

MEMORANDUM

TO: Carmen Chu, City Administrator
Phil Ginsburg, General Manager, Recreation and Parks Department
Alaric Degrafinried, Interim Director, Public Works
Elaine Forbes, Executive Director, Port
Ivar C. Satero, Airport Director
Andrico Penick, Director, Real Estate Division
Rich Hillis, Director, Planning Department
Eric D. Shaw, Director, Mayor's Office of Housing and Community Development
Dr. Grant Colfax, Director, Department of Public Health
Patrick O'Riordan, Director, Department of Building Inspection
Michael Carlin, Acting General Manager, San Francisco Public Utilities Commission

FROM: John Carroll, Assistant Clerk,
Public Safety and Neighborhood Services Committee,
Board of Supervisors

DATE: May 19, 2021

SUBJECT: LEGISLATION INTRODUCED

The Board of Supervisors' Public Safety and Neighborhood Services Committee has received the following proposed legislation, introduced by Supervisor Mandelman on May 11, 2021:

File No. 210536

Ordinance amending the Health Code to 1) lower the threshold, from 250,000 to 100,000 square feet of gross floor area, for requiring that new buildings be constructed, operated, and maintained using specified alternate water sources for required non-potable uses; 2) exempt certain affordable housing projects and property uses from that requirement; 3) require that certain categories of new buildings use specific sources of non-potable water for specific purposes; 4) require that new developments with multiple buildings install an alternate water source system serving the entire development; 5) modify certain administrative review fees; and 6) require the payment of excess use charges and penalties for failure to properly use and maintain alternate water source systems; amending the


Continues on following page

Business and Tax Regulations Code to update certain annual license fee amounts for operating alternate water source systems; and affirming the Planning Department's determination under the California Environmental Quality Act.

If you have any comments or reports to be included with the file, please forward them to me at the Board of Supervisors, City Hall, Room 244, 1 Dr. Carlton B. Goodlett Place, San Francisco, CA 94102.

- c: Offices of Chair Mar and Supervisor Mandelman
Ken Bukowski, Office of the City Administrator
Lihmei Leu, Office of the City Administrator
Tal Quetone, Office of the City Administrator
Sarah Madland, Recreation and Parks Department
David Steinberg, Public Works
Jeremy Spitz, Public Works
John Thomas, Public Works
Lena Liu, Public Works
Amy Quesada, Port
Boris Delepine, Port
Cathy Widener, Airport
Scott Sanchez, Planning Department
Corey Teague, Planning Department
Lisa Gibson, Planning Department
Adam Varat, Planning Department
AnMarie Rodgers, Planning Department
Eugene Flannery, Mayor's Office of Housing and Community Development
Amy Chan, Mayor's Office of Housing and Community Development
Arielle Fleisher, Department of Public Health
Greg Wagner, Department of Public Health
Dr. Naveena Bobba, Department of Public Health
Sneha Patil, Department of Public Health
Patty Lee, Department of Building Inspection
John Murray, Department of Building Inspection
Masood Ordikhani, San Francisco Public Utilities Commission
John Scarpulla, San Francisco Public Utilities Commission

BOARD of SUPERVISORS



City Hall
1 Dr. Carlton B. Goodlett Place, Room 244
San Francisco 94102-4689
Tel. No. (415) 554-5184
Fax No. (415) 554-5163
TDD/TTY No. (415) 554-5227

**NOTICE OF PUBLIC HEARING
PUBLIC SAFETY AND NEIGHBORHOOD SERVICES COMMITTEE
BOARD OF SUPERVISORS OF THE CITY AND COUNTY OF SAN FRANCISCO**

NOTICE IS HEREBY GIVEN THAT the Public Safety and Neighborhood Services Committee of the City and County of San Francisco will hold a remote public hearing to consider the following matter and said public hearing will be held as follows, at which time all interested parties may attend and be heard:

Date: September 9, 2021

Time: 10:00 a.m.

Location: REMOTE MEETING VIA VIDEOCONFERENCE

Watch: www.sfgovtv.org

Watch: SF Cable Channel 26, 78 or 99 (*depending on provider*)

Public Comment Call-In: <https://sfbos.org/remote-meeting-call>

Subject: **File No. 210536.** Ordinance amending the Health Code to 1) lower the threshold, from 250,000 to 100,000 square feet of gross floor area, for requiring that new buildings be constructed, operated, and maintained using specified alternate water sources for required non-potable uses; 2) exempt certain affordable housing projects and property uses from that requirement; 3) require that certain categories of new buildings use specific sources of nonpotable water for specific purposes; 4) modify certain administrative review fees; 5) require the payment of excess use charges and penalties for failure to properly use and maintain alternate water source systems; and 6) the completion of reports on purified water, recycled water, and Non-potable District Systems; amending the Business and Tax Regulations Code to update certain annual license fee amounts for operating alternate water source systems; and affirming the Planning Department's determination under the California Environmental Quality Act.

If passed, this legislation would reduce the threshold for applicability of Health Code, Article 12C for large development projects, with an exemption for 100% affordable housing projects; 100% permanent supportive housing projects; hospital buildings; health service buildings; institutional healthcare use buildings; industrial use buildings; and production, distribution, and repair use buildings. The threshold for a single building or

multiple buildings would be reduced from a total gross floor area of 250,000 square feet or more, to 100,000 square feet or more. Commercial building development projects would be required to reuse blackwater for indoor uses. Multi-family and mixed-use residential building development projects would be required to provide graywater for clothes washing as an end use. Rainwater collection and reuse would be required as alternate water sources. Department enforcement tools would be modified for consistency with current Department procedures, and potential penalties for non-compliance would be increased. The San Francisco Public Utilities Commission would be required to complete reports regarding recycled water use and development, sustainable water heating systems, and the potential uses of renewable natural gas. Health Code, Article 12C would be amended to clarify that development projects are subject to excess use charges for failure to comply with obligations to use alternate water sources.

Department fees to cover the administrative costs of performing inspections and approval and oversight functions would increase. The non-refundable application fees for alternative source water system permits would be increased or decreased as follows, subject to further yearly adjustment without further action by the Board of Supervisors:

- Rainwater, Stormwater, Foundation Drainage: from \$1,544.00 to \$2,616.28;
- Graywater: from \$5,032.00 to \$8,142.66;
- Blackwater: from \$9,034.00 to \$13,958.84;
- Transfer of any permit: from \$229 to \$226;
- District Scale, the applicable amount above, plus \$226 per hour (increased from \$191) for plan review and/or on-site inspection;

On March 17, 2020, the Board of Supervisors authorized their Board and Committee meetings to convene remotely and allow for remote public comment. Therefore, Board of Supervisors meetings that are held through videoconferencing will allow remote public comment. Visit the SFGovTV website (www.sfgovtv.org) to stream the live meetings or watch them on demand.

PUBLIC COMMENT CALL-IN

WATCH: SF Cable Channel 26, 78, or 99 (*depending on your provider*), once the meeting starts, and the telephone number and access code will be displayed on the screen; or

VISIT: <https://sfbos.org/remote-meeting-call>

In accordance with Administrative Code, Section 67.7-1, persons who are unable to attend the hearing on this matter may submit written comments prior to the time the hearing begins. These comments will be made as part of the official public record in this matter and shall be brought to the attention of the Board of Supervisors. Written comments should be addressed to Angela Calvillo, Clerk of the Board, City Hall, 1 Dr. Carlton B. Goodlett Place, Room 244, San Francisco, CA, 94102 or sent via email (board.of.supervisors@sfgov.org). Information relating to this matter is available in the

Office of the Clerk of the Board or the Board of Supervisors' Legislative Research Center (<https://sfbos.org/legislative-research-center-lrc>). Agenda information relating to this matter will be available for public review on Friday, September 3, 2021.

For any questions about this hearing, please contact the Assistant Clerk for the Public Safety and Neighborhood Services Committee:

John Carroll (john.carroll@sfgov.org) ~ (415) 554-4445)

Please Note: *The Department is open for business, but employees are working from home. Please allow 48 hours for us to return your call or email.*


Angela Calvillo
Clerk of the Board of Supervisors

jec:vy:ams

CALIFORNIA NEWSPAPER SERVICE BUREAU

DAILY JOURNAL CORPORATION

Mailing Address : 915 E FIRST ST, LOS ANGELES, CA 90012
Telephone (800) 788-7840 / Fax (800) 464-2839
Visit us @ www.LegalAdstore.com

SF BOS (OFFICIAL) SF
CCSF BD OF SUPERVISORS (OFFICIAL NOTICES)
1 DR CARLTON B GOODLETT PL #244
SAN FRANCISCO, CA 94102

COPY OF NOTICE

Notice Type: GPN GOVT PUBLIC NOTICE

Ad Description

JEC - PSNS Special Hearing - 210536 - September 9, 2021

To the right is a copy of the notice you sent to us for publication in the SAN FRANCISCO EXAMINER. Thank you for using our newspaper. Please read this notice carefully and call us with ny corrections. The Proof of Publication will be filed with the County Clerk, if required, and mailed to you after the last date below. Publication date(s) for this notice is (are):

08/29/2021 , 09/03/2021

The charge(s) for this order is as follows. An invoice will be sent after the last date of publication. If you prepaid this order in full, you will not receive an invoice.

Publication	\$1512.00
Total	\$1512.00

EXM# 3506626

NOTICE OF PUBLIC HEARING PUBLIC SAFETY AND NEIGHBORHOOD SERVICES COMMITTEE BOARD OF SUPERVISORS OF THE CITY AND COUNTY OF SAN FRANCISCO September 9, 2021 - 10:00 a.m.

NOTICE IS HEREBY GIVEN THAT the Public Safety and Neighborhood Services Committee of the City and County of San Francisco will hold a remote public hearing to consider the following matter and said public hearing will be held as follows at which time all interested parties may attend and be heard:

REMOTE MEETING VIA VIDEOCONFERENCE
Watch: www.sfgovtv.org
Watch: SF Cable Channel 26, 78 or 99 (depending on provider) Public Comment Call-In: <https://sfbos.org/remote-meeting-call>

Subject: File No. 210536. Ordinance amending the Health Code to 1) lower the threshold, from 250,000 to 100,000 square feet of gross floor area, for requiring that new buildings be constructed, operated, and maintained using specified alternate water sources for required non-potable uses; 2) exempt certain affordable housing projects and property uses from that requirement; 3) require that certain categories of new buildings use specific sources of nonpotable water for specific purposes; 4) modify certain administrative review fees; 5) require the payment of excess use charges and penalties for failure to properly use and maintain alternate water source systems; and 6) the completion of reports on purified water, recycled water, and Non-potable District Systems; amending the Business and Tax Regulations Code to update certain annual license fee amounts for operating alternate water source systems; and affirming the Planning Department's determination under the California Environmental Quality Act. If passed, this legislation would reduce the threshold for applicability of Health Code, Article 12C for large development projects, with an exemption for 100% affordable housing projects; 100% permanent supportive housing projects; hospital buildings; health service buildings; institutional

healthcare use buildings; industrial use buildings; and production, distribution, and repair use buildings. The threshold for a single building or multiple buildings would be reduced from a total gross floor area of 250,000 square feet or more, to 100,000 square feet or more. Commercial building development projects would be required to reuse blackwater for indoor uses. Multi-family and mixed-use residential building development projects would be required to provide gray water for clothes washing as an end use. Rainwater collection and reuse would be required as alternate water sources. Department enforcement tools would be modified for consistency with current Department procedures, and potential penalties for non-compliance would be increased. The San Francisco Public Utilities Commission would be required to complete reports regarding recycled water use and development, sustainable water heating systems, and the potential uses of renewable natural gas. Health Code, Article 12C would be amended to clarify that development projects are subject to excess use charges for failure to comply with obligations to use alternate water sources. Department fees to cover the administrative costs of performing inspections and approval and oversight functions would increase. The non-refundable application fees for alternative source water system permits would be increased or decreased as follows, subject to further yearly adjustment without further action by the Board of Supervisors: Rainwater, Stormwater, Foundation Drainage: from \$1,544.00 to \$2,616.28; Graywater: from \$5,032.00 to \$8,142.66; Blackwater: from \$9,034.00 to \$13,958.84; Transfer of any permit: from \$229 to \$226; District Scale, the applicable amount above, plus \$226 per hour (increased from \$191) for plan review and/or on-site inspection; On March 17, 2020, the Board of Supervisors authorized their Board and Committee meetings to convene remotely and allow for remote public comment. Therefore, Board of Supervisors meetings that are held through videoconferencing will allow remote



* A 0 0 0 0 0 5 8 1 1 1 5 9 *

public comment. Visit the SFGovTV website (www.sfgovtv.org) to stream the live meetings or watch them on demand. Public Comment Call-In WATCH: SF Cable Channel 26, 78, or 99 (depending on your provider), once the meeting starts, and the telephone number and access code will be displayed on the screen; or VISIT:

<https://sfbos.org/remotemeeting-call>.

In accordance with Administrative Code, Section 67.7-1, persons who are unable to attend the hearing on this matter may submit written comments prior to the time the hearing begins. These comments will be made as part of the official public record in this matter and shall be brought to the attention of the Board of Supervisors.

Written comments should be addressed to Angela Calvillo, Clerk of the Board, City Hall, 1 Dr. Carlton B. Goodlett Place, Room 244, San Francisco, CA, 94102 or sent via email

(board.of.supervisors@sfgov.org). Information relating to this matter is available in the Office of the Clerk of the Board or the Board of Supervisors' Legislative Research Center

(<https://sfbos.org/legislative-research-center-lrc>). Agenda information relating to this matter will be available for public review on Friday, September 3, 2021.

For any questions about this hearing, please contact the Assistant Clerk for the Public Safety and Neighborhood Services Committee: John Carroll

(john.carroll@sfgov.org) ~ (415) 554-4445

Please Note: The Department is open for business, but employees are working from home. Please allow 48 hours for us to return your call or email.

NOTICE OF VOTE CENTERS IN SAN MATEO COUNTY, CALIFORNIA

NOTICE IS HEREBY GIVEN that the California Gubernatorial Recall Election is to be held in the County of San Mateo on the 14th day of September 2021 at which election the polls will be open from the hour of 9:00 AM to the hour of 5:00 PM beginning the 16th of August 2021 until September 13th, 2021, and 7:00 AM to the hour of 8:00 PM on Election Day, the 14th day of September 2021, and that during said hours, said election will be held at the legally designated Vote Centers in the County.

LOCATION NAME	LOCATION	PRECINCTS
30-Day: Weekdays, August 16 to September 14; Weekend, September 4 to September 5 and September 11 to September 12		
Registration & Elections Division	40 Tower Road, San Mateo, CA 94402	All
Assessor-County Clerk-Recorder	555 County Center, Redwood City, CA 94063	All
Main Library	840 West Orange Avenue, South San Francisco, CA 94080	All
11-Day: September 4 to September 14; Weekend, September 4 to September 5 and September 11 to September 12		
City Hall, Council Chambers	501 Primrose Road, Burlingame, CA 94010	All
Pacelli Event Center	145 Lake Merced Boulevard, Daly City, CA 94015	All
Lewis and Joan Platt East Palo Alto Family YMCA, Half Gym	550 Bell Street, East Palo Alto, CA 94303	All
Emergency Operations Center	537 Kelly Avenue, Half Moon Bay CA 94019	All
San Carlos Library, Community Room, 2nd Floor	610 Elm Street, San Carlos, CA 94070	All
4-Day: September 11 to September 14		
Menlo College, El Camino Hall	1000 El Camino Real, Atherton, CA 94027	All
Twin Pines Lodge	40 Twin Pines Lane, Belmont, CA 94002	All
City Hall, Council Chambers	50 Park Place, Brisbane, CA 94005	All
Colma Community Center	1520 Hillside Boulevard, Colma, CA 94014	All
William E. Walker Recreation Center, Art Gallery	650 Shell Boulevard, Foster City, CA 94404	All
Town Hall	1600 Floribunda Avenue, Hillsborough, CA 94010	All
Arrillaga Family Recreation Center, Sequoia Room	700 Alma Street, Menlo Park, CA 94025	All
Community Center	623 Magnolia Avenue, Millbrae, CA 94030	All
St. Peter Parish	700 Oddstad Boulevard, Pacifica, CA 94044	All
Town Center, Community Hall	765 Portola Road, Portola Valley, CA 94028	All
Belle Air Elementary School, PTA Room	450 Third Avenue, San Bruno, CA 94066	All
Woodside Village Church	3154 Woodside Road, Woodside, CA 94062	All
2-Day Pop-Up Voting Centers: September 13 to September 14		
La Honda Fire Brigade	8945 La Honda Road, La Honda, CA 94020	All
La Honda-Pescadero Unified School District Office	360 Butano Cutoff, Pescadero, CA 94060	All

In accordance with Senate Bill 152, on the day of the election and the 3 days preceding the election, the county will provide at least one vote center for every 30,000 registered voters and, beginning 10 days before the election and continuing up to the 4th day before the election, at least one vote center for every 60,000 registered voters.

By order of the Chief Elections Officer & Assessor-County Clerk-Recorder of the County of San Mateo, State of California.

Mark Church

August 29, 2021

Chief Elections Officer & Assessor-County Clerk-Recorder

CNSB#3490035

GOVERNMENT

NOTICE OF PUBLIC HEARING PUBLIC SAFETY AND NEIGHBORHOOD SERVICES COMMITTEE BOARD OF SUPERVISORS OF THE CITY AND COUNTY OF SAN FRANCISCO September 9, 2021 - 10:00 a.m.

NOTICE IS HEREBY GIVEN THAT the Public Safety and Neighborhood Services Committee of the City and County of San Francisco will hold a remote public hearing to consider the following matter and said public hearing will be held as follows, at which time all interested parties may attend and be heard:

REMOTE MEETING VIA VIDEOCONFERENCE Watch: www.sfgovtv.org Watch: SF Cable Channel 26, 78 or 99 (depending on provider) Public Comment Call-In: <https://sfbos.org/remote-meeting-call> Subject: File No. 210536, Ordinance amending the Health Code to 1) lower the threshold, from 250,000 to 100,000 square feet of gross floor area, for requiring that new buildings be constructed, operated, and maintained using specified alternate water sources for required non-potable uses; 2) exempt certain affordable housing projects and property uses from that requirement; 3) require that certain categories of new buildings use specific sources of nonpotable water for specific purposes; 4) modify certain administrative review fees; 5) require the payment of excess use charges and penalties for failure to properly use and maintain alternate water source systems; and 6) the completion of reports on purified water, recycled water, and Non-potable District Systems; amending the Business and Tax Regulations Code to update certain annual license fee amounts for operating alternate water source systems; and affirming the Planning Department's determination under the California Environmental Quality Act. If passed, this legislation would reduce the threshold for applicability of Health Code, Article 12C for large development projects, with an exemption for 100% affordable housing projects; 100% permanent supportive housing projects; hospital buildings; health service buildings; institutional healthcare use buildings; industrial use buildings; and production, distribution, and repair use buildings. The threshold for a single building or multiple buildings would be reduced from a total gross floor area of 250,000 square feet or more, to 100,000 square feet or more. Commercial building development projects would be required to reuse blackwater for indoor uses. Multi-family and mixed-use residential building development projects would be required to provide graywater for clothes washing as an end use. Rainwater collection and reuse would be required as alternate water sources. Department enforcement tools would be modified for consistency with current Department procedures, and potential penalties for

non-compliance would be increased. The San Francisco Public Utilities Commission would be required to complete reports regarding recycled water use and development, sustainable water heating systems, and the potential uses of renewable natural gas. Health Code, Article 12C would be amended to clarify that development projects are subject to excess use charges for failure to comply with obligations to use alternate water sources. Department fees to cover the administrative costs of performing inspections and approval and oversight functions would increase. The non-refundable application fees for alternative source water system permits would be increased or decreased as follows, subject to further yearly adjustment without further action by the Board of Supervisors: Rainwater, Stormwater, Foundation Drainage: from \$1,544.00 to \$2,616.28; Graywater: from \$5,032.00 to \$8,142.66; Blackwater: from \$9,034.00 to \$13,958.84; Transfer of any permit: from \$229 to \$226; District Scale, the applicable amount above, plus \$226 per hour (increased from \$191) for plan review and/or on-site inspection; On March 17, 2020, the Board of Supervisors authorized their Board and Committee meetings to convene remotely and allow for remote public comment. Therefore, Board of Supervisors meetings that are held through videoconferencing will allow remote public comment. Visit the SFGovTV website (www.sfgovtv.org) to stream the live meetings or watch them on demand. Public Comment Call-In WATCH: SF Cable Channel 26, 78, or 99 (depending on your provider), once the meeting starts, and the telephone number and access code will be displayed on the screen; or VISIT: <https://sfbos.org/remote-meeting-call>. In accordance with Administrative Code, Section 67.7-1, persons who are unable to attend the hearing on this matter may submit written comments prior to the time the hearing begins. These comments will be made as part of the official public record in this matter and shall be brought to the attention of the Board of Supervisors. Written comments should be addressed to Angela Calvillo, Clerk of the Board, City Hall, 1 Dr. Carlton B. Goodlett Place, Room 244, San Francisco, CA, 94102 or sent via email (boardofsupervisors@sfgov.org). Information relating to this matter will be available for public review on Friday, September 3, 2021. For any questions about this hearing, please contact the Assistant Clerk for the Public Safety and Neighborhood Services Committee: John Carroll (john.carroll@sfgov.org) - (415) 554-4445. Please Note: The Department is open for business, but employees are working from home. Please allow 48 hours for us to return your call or email.

NOTICE OF HEARING ON PROPOSED MUNICIPAL RAILWAY FARE CHANGE FOR CUSTOMERS 18 YEARS OF AGE AND YOUNGER. The San Francisco Municipal Transportation Agency Board of Directors will hold a public hearing on Tuesday, September 7, 2021, to discuss retroactively approving a twelve-month pilot program beginning August 15, 2021 through August 14, 2022 waiving Muni fares for regular service for customers 18 years of age and younger, students enrolled in the San Francisco Unified School District's English Learner and Special Education Services programs through the age of 22, and cable car fares for San Francisco youth. Due to COVID-19 restrictions, the hearing will be held online at 1 P.M. More information can be found at www.sfmta.com.

NOTICE OF PUBLIC HEARING BOARD OF SUPERVISORS OF THE CITY AND COUNTY OF SAN FRANCISCO BUDGET AND FINANCE COMMITTEE SEPTEMBER 8, 2021 - 10:30 AM REMOTE MEETING VIA VIDEOCONFERENCE Watch: www.sfgovtv.org Watch: SF Cable Channel 26, 78 or 99 (depending on your provider) once the meeting starts, the telephone number and Meeting ID will be displayed on the screen. Public Comment Call-In: <https://sfbos.org/remote-meeting-call>

NOTICE IS HEREBY GIVEN THAT the Budget and Finance Committee will hold a public hearing to consider the following proposal and said public hearing will be held as follows, at which time all interested parties may attend and be heard: File No. 210654, Ordinance authorizing the Municipal Transportation Agency (SFMTA) to set parking rates at the Kezar Stadium Parking Lot, Golden Gate Park Underground Parking Facility, and Marina Small Craft Harbor in accordance with Park Code provisions that authorize SFMTA rate-setting on park property; making conforming edits to the Park Code; increasing parking rates for berth-holders at the Marina Small Craft Harbor; and affirming the Planning Department's determination under the California Environmental Quality Act. In accordance with Park Code, Section 6.14, the Board of Supervisors approves the implementation of paid parking with rates set by the Municipal Transportation Agency and subject to approval by the Recreation and Park Commission at the Kezar Stadium Parking Lot, the Golden Gate Park Underground Parking Facility, and the Marina Small Craft Harbor. If the legislation passes, excluding the Kezar Stadium Parking Lot, the daily fee for parking on other Recreation and Park Department property, except for garages and specifically designated parking lots subject to separate fee-setting procedures, shall be from \$0.50 to \$1 per hour, the amount to be determined by the Recreation and Park Commission after considering the costs of parking in the areas adjacent to the park property. Additionally, the rate for berthholders at the Marina

Small Craft Harbor to purchase each additional permit would increase from \$120 to \$600 annually. On March 17, 2020, the Board of Supervisors (Board) authorized their Board and Committee meetings to convene remotely and allow remote public comment via teleconference. Effective June 29, 2021, full Board meetings began to reconvene for in-person Board proceedings. Committee meetings will continue to convene remotely until further notice. Visit the SFGovTV website at (www.sfgovtv.org) to stream the live meetings, or to watch meetings on demand. Public Comment Call-In WATCH: SF Cable Channel 26, 78 or 99 (depending on your provider), once the meeting starts, the telephone number and Meeting ID will be displayed on the screen; or VISIT: <https://sfbos.org/remote-meeting-call> Please visit the Board's website (<https://sfbos.org/city-board-response-covid-19>) regularly to be updated on the City's response to COVID-19 and how the legislative process may be impacted. In accordance with Administrative Code, Section 67.7-1, persons who are unable to attend the hearing on this matter may submit written comments prior to the time the hearing begins. These comments will be made as part of the official public record in this matter and shall be brought to the attention of the Board of Supervisors. Written comments should be addressed to Angela Calvillo, Clerk of the Board, City Hall, 1 Dr. Carlton B. Goodlett Place, Room 244, San Francisco, CA, 94102 or sent via email (boardofsupervisors@sfgov.org). Information relating to this matter is available in the Office of the Clerk of the Board or the Board of Supervisors' Legislative Research Center (<https://sfbos.org/legislative-research-center-irc>). Agenda information relating to this matter will be available for public review on Friday, September 3, 2021. For any questions about this hearing, please contact Linda Wong, the Clerk of the Board and Appropriations Committee: Linda Wong (Linda.Wong@sfgov.org) - (415) 554-7719. Please Note: The Department is open for business, but employees are working from home. Please allow 48 hours for us to return your call or email. Angela Calvillo Clerk of the Board of Supervisors City and County of San Francisco

BULK SALES

NOTICE TO CREDITORS OF BULK SALE (UCC SEC. 6105)

Escrow No. 13887D
NOTICE IS HEREBY GIVEN that a bulk sale is about to be made. The name(s), business address(es) to the seller(s) are: MYKONOS JAX LLC, 732 LAUREL ST, SAN CARLOS, CA 94070
Whose chief executive office is: NONE
Doing Business as: NICK THE GREEK (STORE #103) (Type - FRANCHISED RESTAURANT)
All other business name(s) and address(es) used by the seller(s) within the past three years, as stated by the

Public Hearing Notice

Sixth Cycle Regional Housing Needs Assessment (RHNA) Appeals Hearing

Public Notice is hereby given that the Association of Bay Area Governments (ABAG) will conduct a public hearing on the dates identified below to hear appeals of the draft regional housing need allocations distributed to local jurisdictions as part of the Draft RHNA Allocation Plan released by ABAG on May 25, 2021. These public hearings will be held as part of ABAG's effort to prepare a Final RHNA Plan for the ABAG region in accordance with state law.

This public hearing is being held pursuant to Government Code Section 65584.05(d) and provides opportunity for jurisdictions that filed appeals to provide testimony before the RHNA Administrative Committee as part of the Committee's determination on appeals. In addition, the public hearings are part of ABAG's efforts relating to the Sixth Cycle RHNA process and preparing a Final RHNA Allocation Plan as required by the State for local jurisdictions to prepare updated General Plan Housing Elements. Each hearing is a continuation of the prior appeals hearing.

The public hearing and subsequent continuations will occur as follows. Hearing accessibility instructions (Zoom Link) also will be posted to: <https://abag.ca.gov/meetings> no less than 72 hours prior to the hearing and the continuations.

RHNA Appeals Day 1 (Remotely)

Friday 9/24/2021, 9:00a to 5:00p
 Zoom Link: TBD
 Bay Area Metro Center
 Board Room, 1st Floor
 375 Beale Street, San Francisco, CA
 94105

RHNA Appeals Day 4

Friday 10/15/2021, 1:00p to 5:00p
 Bay Area Metro Center
 Board Room, 1st Floor
 375 Beale Street, San Francisco, CA
 94105

RHNA Appeals Day 2 (Remotely)

Wednesday 9/29/2021, 9:00a to 1:00p
 Zoom Link: TBD
 Bay Area Metro Center
 Board Room, 1st Floor
 375 Beale Street, San Francisco, CA
 94105

RHNA Appeals Day 5

Friday 10/22/2021, 9:00a to 5:00p
 Bay Area Metro Center
 Board Room, 1st Floor
 375 Beale Street, San Francisco, CA
 94105

RHNA Appeals Day 3

Friday 10/8/2021, 2:00p to 5:00p
 Bay Area Metro Center
 Board Room, 1st Floor
 375 Beale Street, San Francisco, CA
 94105

RHNA Appeals Day 6

Friday 10/29/2021, 9:00a to 5:00p
 Bay Area Metro Center
 Board Room, 1st Floor
 375 Beale Street, San Francisco, CA
 94105

In light of Governor Newsom's State of Emergency declaration regarding the COVID-19 outbreak and in accordance with the Governor's Executive Order N-29-20, issued on March 17, 2020, and currently scheduled to expire on September 30, and the Guidance for Gatherings issued by the California Department of Public Health, the meeting will be conducted via webcast, teleconference, and Zoom for all participants. Detailed instructions on participating via Zoom are available at: <https://abag.ca.gov/meetings-events/meetings/how-provide-public-comment-board-meeting-zoom%2%A0>. The meeting accessibility instructions also will be posted to: <https://abag.ca.gov/meetings> no less than 72 hours prior to the hearing.

Upon completion of the appeals hearings, the Administrative Committee action on appeals is scheduled to occur on November 12th with release of the final allocation tentatively scheduled for November 15th. The ABAG Executive Board will conduct a final public hearing later this fall, prior to the adoption of the final allocation plan.

Additional information relevant to this public hearing may be found at: <https://abag.ca.gov/our-work/housing/rhna-regional-housing-needs-allocation>. If you have any questions or would like to submit public comment, please contact RHNA@bayareametro.gov.

Do you need an interpreter or any other assistance to participate? Please call 415-778-6757. We require at least three working days' notice to accommodate assistance requests. For TDD or hearing impaired, call 711, California Relay Service, or 1-800-735-2929 (TTY), 1-800-735-2922 (voice) and ask to be relayed to 415-778-6700.

您需要口譯員或任何其他幫助才能參加嗎? 請致電415-778-6757。我們要求至少提前三個工作日通知, 以便滿足您的請求。對於TDD或聽障人士, 請致電711, 加州中繼服務, 或1-800-735-2929(TTY), 1-800-735-2922(語音), 並要求轉接到415-778-6700。

¿Necesita un intérprete o cualquier otra ayuda para participar? Llame al 415-778-6757. Requerimos un aviso de al menos tres días hábiles para atender las solicitudes de asistencia. Para personas con discapacidad auditiva o TDD, llame al 711, California Relay Service, o al 1-800-735-2929 (TTY) o al 1-800-735-2922 (voz) y pida que lo comuniquen al 415-778-6700.

CNSB#3502939




City Council Virtual Study Session

September 8, 2021 5:30 PM

www.SanCarlosInnovation.org

The City of San Carlos has been working with the community and stakeholders to develop urban design strategies for the City's east side industrial area from Holly Street to Brittan Avenue, known as the **East Side Innovation District**. At this City Council Study Session, "10 Big Moves", or strategies will be presented. These strategies translate the community's aspirations for the East Side into a holistic design framework that will inform future development and infrastructure improvements for the next 10 to 20 years. In addition, an overview of a new **community benefits framework** for ensuring future development in the district benefits all members of the greater San Carlos community will be presented. Please join us!

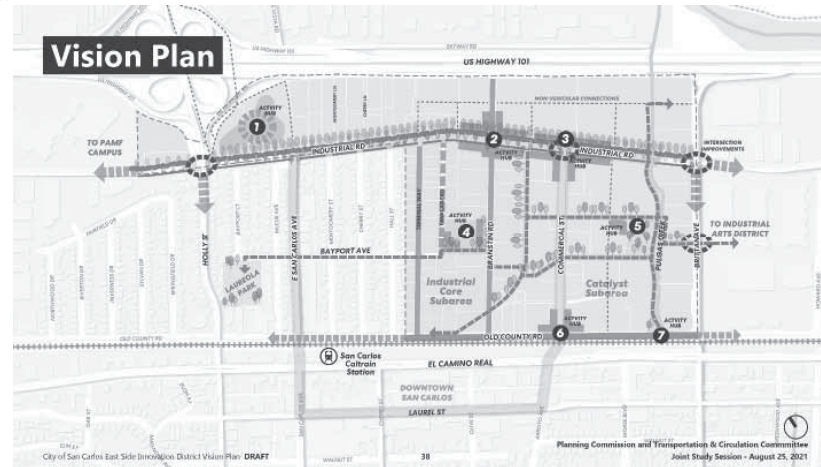

To learn more and review materials from previous community workshops, please visit www.SanCarlosInnovation.org.

Below are three options to observe this virtual study session:

- Zoom Webinar.** <https://us02web.zoom.us/j/81401424082> or call 1-669-900-9128 and enter the Meeting ID: 814 0142 4082
- Meeting Webportal.** www.sancarlosca.ig2.com
- Local TV.** Comcast Channel 27 and AT&T Uverse Channel 99

Public Comments in Zoom Webinar: If you plan to make a public comment, please observe the meeting via Zoom Webinar (see above access information) and during the public comment period for the agenda item you wish to address, use the "raise hand" feature. If joining by phone, press *9 to "raise hand."

Public Comments in Webportal or Local TV: If you plan to make a public comment while watching through the Webportal or Local TV, dial 1-669-900-9128 and enter the Meeting ID: 814 0142 4082. Press *9 to "raise hand" and notify staff of your wish to provide a public comment.

CNSB#3507719

Subject: File No. 210536.

Ordinance amending the Health Code to 1) lower the threshold, from 250,000 to 100,000 square feet of gross floor area, for requiring that new buildings be constructed, operated, and maintained using specified alternate water sources for required non-potable uses; 2) exempt certain affordable housing projects and property uses from that requirement; 3) require that certain categories of new buildings use specific sources of nonpotable water for specific purposes; 4) modify certain administrative review fees; 5) require the payment of excess use charges and penalties for failure to properly use and maintain alternate water source systems; and 6) the completion of reports on purified water, recycled water, and Non-potable District Systems; amending the Business and Tax Regulations

Code to update certain annual license fee amounts for operating alternate water source systems; and affirming the Planning Department's determination under the California Environmental Quality Act. If passed, this legislation would reduce the threshold for applicability of Health Code, Article 12C for large development projects, with an exemption for 100% affordable housing projects; 100% permanent supportive housing projects; hospital buildings; health service buildings; institutional healthcare use buildings; industrial use buildings; and production, distribution, and repair use buildings. The threshold for a single building or multiple buildings would be reduced from a total gross floor area of 250,000 square feet or more, to 100,000 square feet or more. Commercial building

development projects would be required to reuse blackwater for indoor uses. Multi-family and mixed-use residential building development projects would be required to provide graywater for clothes washing as an end use. Rainwater collection and reuse would be required as alternate water sources. Department enforcement tools would be modified for consistency with current Department procedures, and potential penalties for non-compliance would be increased. The San Francisco Public Utilities Commission would be required to complete reports regarding recycled water use and development, sustainable water heating systems, and the potential uses of renewable natural gas. Health Code, Article 12C would be amended to clarify that development projects are subject to excess

use charges for failure to comply with obligations to use alternate water sources. Department fees to cover the administrative costs of performing inspections and approval and oversight functions would increase. The non-refundable application fees for alternative source water system permits would be increased or decreased as follows, subject to further yearly adjustment without further action by the Board of Supervisors: Rainwater, Stormwater, Foundation Drainage: from \$1,544.00 to \$2,616.28; Graywater: from \$5,032.00 to \$8,142.66; Blackwater: from \$9,034.00 to \$13,958.84; Transfer of any permit: from \$229 to \$226; District Scale, the applicable amount above, plus \$226 per hour (increased from \$191) for plan review and/or on-site inspection; On March 17, 2020, the Board

of Supervisors authorized their Board and Committee meetings to convene remotely and allow for remote public comment. Therefore, Board of Supervisors meetings that are held through videoconferencing will allow remote public comment. Visit the SFGovTV website (www.sfgovtv.org) to stream the live meetings or watch them on demand. Public Comment Call-In WATCH: SF Cable Channel 26, 78, or 99 (depending on your provider), once the meeting starts, and the telephone number and access code will be displayed on the screen; or VISIT: <https://sfbos.org/remote-meeting-call>. In accordance with Administrative Code, Section 67.7-1, persons who are unable to attend the hearing on this matter may submit written comments prior to the time the hearing begins. These comments will be made as part of the official public record in this matter and shall be brought to the attention of the Board of Supervisors. Written comments should be addressed to Angela Calvillo, Clerk of the Board, City Hall, 1 Dr. Carlton B. Goodlett Place, Room 244, San Francisco, CA, 94102 or sent via email (board_of_supervisors@sfgov.org). Information relating to this matter is available in the Office of the Clerk of the Board or the Board of Supervisors' Legislative Research Center (<https://sfbos.org/legislative-research-center-lrc>). Agenda information relating to this matter will be available for public review on Friday, September 3, 2021. For any questions about this hearing, please contact the Assistant Clerk for the Public Safety and Neighborhood Services Committee: John Carroll (john.carroll@sfgov.org) - (415) 554-4445. Please Note: The Department is open for business, but employees are working from home. Please allow 48 hours for us to return your call or email.

CITATION
 SUPERIOR COURT FOR THE STATE OF CALIFORNIA FOR THE CITY AND COUNTY OF SAN FRANCISCO
 UNITED FAMILY COURT
 Case Number: JD21-3094
 In the Matter of: ESCOBAR, Alexa, A Minor
 To: Wendy Escobar, Mother; and any other persons(s) claiming to be the Parent(s) of said minor.

You are hereby notified that the San Francisco Juvenile Dependency Court has ordered a hearing pursuant to Welfare and Institutions Code Section 366.26, to determine whether your parental rights should be terminated and your child(ren) be freed from your custody and control for the purpose of having him adopted. BY ORDER OF THIS COURT, you are hereby cited and required to appear before this Court on the day of October 13, 2021 at 8:45 AM, at the Juvenile Dependency Court, 406 McAllister Street, Room 406, San Francisco, California, then and there to show cause, if any you have, why said minor(s) should not be declared free from the custody and control of his parent(s). This proceeding is for the purpose of developing a permanent plan for the child(ren), which could include

GOVERNMENT

NOTICE OF PUBLIC HEARING PUBLIC SAFETY AND NEIGHBORHOOD SERVICES COMMITTEE BOARD OF SUPERVISORS

OF THE CITY AND COUNTY OF SAN FRANCISCO September 9, 2021 - 10:00 a.m.

NOTICE IS HEREBY GIVEN THAT the Public Safety and Neighborhood Services Committee of the City and County of San Francisco will hold a remote public hearing to consider the following matter

and said public hearing will be held as follows, at which time all interested parties may attend and be heard:

REMOTE MEETING VIA VIDEOCONFERENCE Watch: www.sfgovtv.org Watch: SF Cable Channel 26, 78 or 99 (depending on provider) Public Comment Call-In: <https://sfbos.org/remote-meeting-call>

From: [Aron Tartakovsky](#)
To: [Carroll, John \(BOS\)](#)
Subject: Support Re: File 210536, Onsite Water Reuse
Date: Thursday, September 9, 2021 12:28:42 PM
Attachments: [ect_961e5543-47a0-4f4b-9d9c-97a03d2a7da7.png](#)
[Public Safety and Neighborhood Services Committee.pdf.pdf](#)

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Mr. Carroll,

Please find attached my public comment letter regarding File number 210536 for the Thursday Sep. 9 Public Safety and Neighborhood Services Committee meeting.

Thank you,
Aaron

Aaron Tartakovsky



449 10th Street | San Francisco, CA 94103
[415.244.1399](tel:415.244.1399) | aaron@epiccleantec.com
epiccleantec.com



Public Safety and Neighborhood Services Committee
San Francisco Board of Supervisors
1 Dr. Carlton B. Goodlett Place
City Hall, Room 244
San Francisco, CA 94102

September 8, 2021

Dear Supervisors,

My name is Aaron Tartakovsky, a lifelong resident of San Francisco and the co-founder and CEO of Epic Cleantec, a sustainability company helping to deploy onsite water reuse firms into the built environment.

I am writing to express strong support for the proposed update to San Francisco's onsite water reuse program (Alternate Water Sources for Non-Potable Applications; File Number: 210536).

With the combined challenges of aging water and wastewater infrastructure, growing urban populations, and an increasingly unpredictable climate, we simply need to do things differently when it comes to how we manage our water resources.

A key tactic in helping to build resilience in the midst of prolonged periods of water scarcity is diversifying the water supply portfolio, which is to say, ensuring that we have multiple sources upon which to draw water for our non-potable uses. By reusing water onsite for non-potable applications such as toilet and urinal flushing, irrigation, cooling towers, and laundry, a building can reuse up to 95% of its water – that is up to 95% less water that these buildings will need to draw from the city's pristine potable water supply for their non-potable needs.

In the 21st century, with all of the technological capabilities at our disposal, we should not have to rely on whether or not it rains to ensure we have enough water supply for our communities. This ordinance is a very positive step in the right direction that will serve as a model for cities in California, across the United States, and throughout the world.

Sincerely,
Aaron Tartakovsky

A handwritten signature in black ink, appearing to read "Aaron Tartakovsky", written in a cursive style.

Epic Cleantec
449 10th Street, San Francisco, CA 94103

From: [Alice Jolimaitre](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); [Safai, Ahsha \(BOS\)](#)
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Wednesday, September 8, 2021 7:49:16 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 11 and a member of the SF Climate Emergency Coalition, I support water reuse and recycling both as

- **a necessary climate change adaptation** and
- the starting point of a **just transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water-recycling pipe.

Sincerely,

Alice Jolimaitre

From: [Laura Feinstein](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Bintliff, Jacob \(BOS\)](#)
Subject: Public Comment for 9/9 PS Committee, File No 10536
Date: Wednesday, September 8, 2021 6:16:03 PM
Attachments: [SPUR letter recycled water 210536_090821.pdf](#)

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Mr. Carroll,

Please find attached SPUR's public comment letter regarding File number 10536 for the Thursday Sep. 9 Public Safety and Neighborhood Services Committee meeting.

Best regards,

Laura Feinstein

—
Laura Feinstein, PhD (she • her • they)
Sustainability and Resilience Policy Director
530.204.8325 (cell)
1.510.827.1286 (google voice)
lfeinstein@spur.org



The [SPUR Regional Strategy](#) has landed

[Join](#) | [Get Newsletters](#) | [Twitter](#) | [LinkedIn](#)

9/8/2021

Public Safety and Neighborhood Services Committee
San Francisco Board of Supervisors
1 Dr. Carlton B. Goodlett Place
City Hall, Room 244
San Francisco, CA 94102

Dear Supervisors,

On behalf of SPUR, I am writing to express wholehearted support for the proposed ordinance to expand San Francisco reliance on alternate water sources for non-potable applications (File Number: 210536).

Climate change models project that periods of severe drought in Northern California will dramatically worsen before the end of the century.¹ Northern California experienced the worst drought in a millennium from 2012-16, and the current drought is on track to be more severe than the last. With climate change, San Francisco cannot afford to delay investing in alternative water supplies.

The proposed ordinance lowers the minimum square footage for new buildings required to construct onsite water reuse systems. Recycled water would be used for non-drinking purposes such as toilet flushing, urinal flushing, clothes washing, and outdoor irrigation.

Water reuse is a key strategy for the city to balance its need to address the housing shortage, continue to grow economically, and do so within the limits of its water supplies. And unlike the city's main source of water, the Hetch-Hetchy water system, recycled water isn't diverted from upstream rivers and streams that are already suffering from water shortages.

We applaud San Francisco's strong track record in advancing onsite non-potable water reuse and support the city's efforts to expand its reliance on alternative, drought-resilient water supplies.

Sincerely,



Laura Feinstein, Ph.D.
Sustainability and Resilience Policy Director

¹ Ackerly, David, Andrew Jones, and Bruce Riordan. *California's Fourth Climate Change Assessment: San Francisco Bay Area Region Report*. Accessed March 5, 2021. <https://barc.ca.gov/sites/default/files/documents/2020-12/20190116-sanfranciscobayarea.pdf>.

From: [JB Tengco](#)
To: [Carroll, John \(BOS\)](#)
Subject: Support: Alternate Water Sources for Non-Potable Applications
Date: Wednesday, September 8, 2021 6:07:10 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

On behalf of the BlueGreen Alliance – a national organization of labor and environmental partners – and as a San Francisco resident, I write to support Ordinance# 210536 - Alternate Water Sources for Non-Potable Applications. With climate change and the water crisis, BGA believe this ordinance is an important step to addressing both crises and serves as a model for the state and country. We believe this ordinance is good for the environment, good for the community and good for workers; we respectfully ask you to approve this essential water conservation ordinance.

Yours truly,

Jose “JB” Tengco
Vice President, State Affairs | BlueGreen Alliance

From: [Lorrie J. LeLe](#)
To: [Carroll, John \(BOS\)](#); [Carlin, Michael \(PUC\)](#)
Cc: [Bintliff, Jacob \(BOS\)](#); dfahy@ualocal38.org; [Aaron Stockwell \(aaron@calpipes.org\)](mailto:Aaron.Stockwell@calpipes.org); [Larry Mazzola - UA Plumbers & Pipefitters, Local 38 \(lmazzolajr@ualocal38.org\)](#); [Thomas A. Enslow](#)
Subject: Agenda Item 5, September 9, 2021, Public Safety & Neighborhood Services Committee (File # 210536); Proposal for Expansion of Requirements for Alternate Water Sources for Non-Potable Applications (4846)
Date: Wednesday, September 8, 2021 3:50:02 PM
Attachments: [4846-002j - Local 38 support letter for Agenda Item 5 PSNS comm - Water reuse ordinance \(9-8-21\).pdf](#)

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Please find attached correspondence regarding the above referenced subject matter.

Thank you,

Lorrie LeLe

Legal Assistant

Adams Broadwell Joseph & Cardozo

520 Capitol Mall, Suite 350

Sacramento, CA 95814

ljele@adamsbroadwell.com | Phone: 916.444.6201 Ext. 10 | Fax: 916.444.6209 |

This e-mail may contain material that is confidential, privileged and/or attorney work product for the sole use of the intended recipient. Any review, reliance or distribution by others or forwarding without express permission is strictly prohibited. If you are not the intended recipient, please contact the sender and delete all copies.

ADAMS BROADWELL JOSEPH & CARDOZO

A PROFESSIONAL CORPORATION

ATTORNEYS AT LAW

520 CAPITOL MALL, SUITE 350
SACRAMENTO, CA 95814-4721

TEL: (916) 444-6201
FAX: (916) 444-6209

tenslow@adamsbroadwell.com

SO. SAN FRANCISCO OFFICE

601 GATEWAY BLVD., SUITE 1000
SO. SAN FRANCISCO, CA 94080

TEL: (650) 589-1660
FAX: (650) 589-5062

KEVIN T. CARMICHAEL
CHRISTINA M. CARO
JAVIER J. CASTRO
THOMAS A. ENSLOW
KELILAH D. FEDERMAN
ANDREW J. GRAF
TANYA A. GULESSERIAN
KENDRA D. HARTMANN*
DARIEN K. KEY
RACHAEL E. KOSS
AIDAN P. MARSHALL
TARA C. MESSING

Of Counsel

MARC D. JOSEPH
DANIEL L. CARDOZO

**Not admitted in California.
Licensed in Colorado.*

September 8, 2021

Sent Via Email and Overnight Mail

Public Safety and Neighborhood Services Committee Members
c/o John Carroll, Assistant Clerk
San Francisco Board of Supervisors
City Hall, 1 Dr. Carlton B. Goodlett Place
San Francisco, CA 94102
john.carroll@sfgov.org

Michael Carlin
Acting General Manager
San Francisco Public Utilities Commission
525 Golden Gate Avenue
San Francisco, CA 94102
MCarlin@sfwater.org

**Subject: Agenda Item 5, September 9, 2021, Public Safety and
Neighborhood Services Committee (File # 210536); Proposal for
Expansion of Requirements for Alternate Water Sources
for Non-Potable Applications**

Dear Mr. Carlin and Mr. Bintliff,

I am writing on behalf of the California State Pipe Trades Council and Plumbers and Pipefitters UA Local 38 in strong support of adoption of proposed Ordinance 210536 - Alternate Water Sources for Non-Potable Applications. Among other actions, the proposed ordinance amends the City Health Code to (1) lower the threshold from 250,000 to 100,000 square feet of gross floor area for requiring that new buildings be constructed, operated, and maintained using specified alternate water sources for required non-potable uses; (2) exempt certain affordable housing

4846-002j

projects and property uses from that requirement; (3) require that certain categories of new buildings use specific sources of non-potable water for specific purposes; and (4) requires completion of reports on purified water, recycled water, and Non-potable District Systems.

This proposal before you was developed pursuant to Section 909, subdivision (c) of Ordinance 200701 (All-Electric Building Standard), which requires: “Concurrent with implementation of the All-Electric building requirement, the San Francisco Public Utilities Commission will evaluate opportunities for the expansion of non-potable onsite water treatment systems, graywater heat recovery systems, and solar thermal water heating, and shall present findings and recommendations to the Board of Supervisors by no later than March 1, 2021.”

The California State Pipe Trades Council and UA Local 38 would like to thank Supervisor Mandelman for his leadership in moving this ordinance forward, along with the co-sponsors, Supervisors Mar, Malgar and Ronen. We would also like to thank the leadership and staff at the SFPUC and the San Francisco Department of Environment. In particular, Michael Carlin, Paula Kehoe, John Scarpulla, Barry Hooper and Cyndy Comerford have been invaluable in identifying a pathway to expand the City’s water re-use requirements in a reasonable and feasible way.

We look forward to continued collaboration with the City particularly as it seeks to identify and implement recommendations from the reports required under this ordinance related to expansion of the City’s recycled water treatment facilities and purple water district maps, renewable gas pilot projects and opportunities to implement more efficient water pre-heating technologies such as thermal solar systems, geothermal hot water systems, and gray/wastewater pre-heating systems.

In addition, we would like to thank Sierra Club, NRDC and Blue Green Alliance for their longstanding work on water conservation issues and their recognition of the natural relationship between building decarbonization efforts and building water efficiency efforts. We would also like to thank them for their commitment to recognizing the need to identify a just transition path where greenhouse gas reduction policies inequitably impact certain classes of workers.

Currently 100% of California is experiencing drought conditions, with 96% of the state in severe drought conditions and 88% in extreme drought conditions.¹ California Reservoirs, such as Lake Oroville are at historic low levels. Reservoirs fed by the Colorado River have also fallen to historically low levels.² Droughts of this severity are expected to increase in frequency as a result of climate change.

The California Department of Water Resources recently released a report finding that “Climate change is expected to affect California’s water supply conditions over the long term, with a significant impact being reduction in mountain snowpack.”³ The Governor’s Office of Planning and Research, the California Energy Commission, and the California Natural Resources Agency released their Fourth Climate Change Assessment in 2018, which concluded that “[b]y 2050, the average water supply from snowpack is projected to decline to 2/3 from historical levels. If emissions reductions do not occur, water from snowpack could fall to less than 1/3 of historical levels by 2100.”⁴ The Public Policy Institute of California, a non-profit non-partisan think tank noted “California’s climate is warming and becoming more variable. **Rising temperatures are making droughts more intense, and dry years are occurring more frequently.**”⁵

Water reuse is one of the most efficient and cost-effective ways to improve drought resilience in California. Currently, most buildings use potable water to supply the non-potable water demands from toilet and urinal flushing, floor trap priming, cooling towers, and air-conditioning devices. Dual plumbing of buildings allows those non-potable water demands to be met by non-potable water sources such as recycled water or onsite-treated graywater, rainwater and foundation drainage. Onsite treatment and reuse of available onsite rainwater, graywater and foundation drainage in buildings provides a proven avenue for reducing the use of potable water in non-potable water building applications where recycled water is not available for such uses. Water reuse also reduces long term operational costs for a building, particularly as potable water costs rise with supplies not meeting demand. This reduction in annual utility costs particularly benefits owners and tenants of multi-family affordable housing units.

¹ <https://www.drought.gov/states/california>.

² <https://www.dailymail.co.uk/news/article-9962047/California-droughts-reduce-Lake-Oroville-levels-historic-low-24-cent-capacity.html>.

³ [DWR: Drought in California 2021 at p. 10.](#)

⁴ California’s Fourth Climate Change Assessment, summary brochure pg.5, https://www.energy.ca.gov/sites/default/files/2019-11/20180827_Summary_Brochure_ADA.pdf

⁵ [Public Policy Institute, Water and a Changing Climate at p. 1-2.](#)

The City's current mandates to re-use graywater and wastewater in order to reduce water demand are no longer sufficient. The SFPUC has estimated that the proposed changes in this ordinance could double the amount of water savings in residential and mixed-use buildings to 30% of total indoor potable water demand and offset up to 75% of total indoor potable water demand in commercial buildings, up from the 15% conserved under current requirements. These additional savings would offset the water use of roughly 5,500 San Francisco residents per day.

This ordinance not only expands those water reuse requirements it also provides the dual benefit of ensuring that plumbers who may lose jobs due to building electrification mandates are provided a just transition. This ordinance fulfills the promise of a new green economy by replacing lost jobs installing gas piping with new plumbing jobs making buildings drought resistant. Adopting water-reuse requirements concurrently with building electrification requirements reduces impacts on workers at minimal additional cost to builders. Where gas piping is eliminated, dual piping for non-potable water uses will be installed in its place.

This ordinance is a major step forward for San Francisco in creating buildings for the 21st century that are less greenhouse gas intensive, are drought-resistant, and continue to provide good jobs for plumbers and other construction workers in San Francisco. The California State Pipe Trades Council and UA Local 38 respectfully urges adoption of this ordinance.

Sincerely,

A handwritten signature in blue ink that reads "Thomas A. Enslow". The signature is fluid and cursive, with a long horizontal stroke at the end.

Thomas A. Enslow

TAE:lj1

cc: Jacob Bintliff, jacob.bintliff@sfgov.org

From: [Melissa Yu](#)
To: [Carroll, John \(BOS\)](#)
Subject: Sierra Club support the water reuse ordinance
Date: Wednesday, September 8, 2021 2:48:13 PM
Attachments: [Water Reuse Ordinance Support Letter.pdf](#)

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Hi John,

Please find attached the Sierra Club's letter.

Best,

Melissa

--

Melissa Yu
Conservation Program Coordinator
[Sierra Club, San Francisco Bay Chapter](#)
Office: (510) 848 - 0800
Cell: (415) 870 - 3142





Serving Alameda, Contra Costa, Marin and San Francisco counties

September 8, 2021

City Hall
1 Dr. Carlton B. Goodlett Place
San Francisco, CA 94102-4689

Attn: Clerk John Carroll (John.Carroll@sfgov.org)

Dear Public Safety and Neighborhood Services Committee,

The Sierra Club is excited to support the water reuse ordinance that would double the amount of water that large buildings are required to collect and reuse. California is entering yet another drought after two consecutive dry winters greatly diminished key water supplies, including the Sierra Nevada snowpack that measured only 60% of its average capacity as of April 1st. With California droughts intensifying due to the effects of climate change, we must take immediate action to ensure a sustainable water supply for years to come.

As our summers get hotter and dryer, this compounds the likelihood of wildfires amid California's worsening drought conditions. This ordinance is much needed as droughts not only endanger public health and safety but also cause long-term negative environmental and economic impacts. Public health and safety threats primarily include increased risk of catastrophic wildfires and drinking water shortages.

As Hunter Cutting of the Sierra Club SF Group states, "This is smart matchmaking between two critically important environmental priorities – water reuse and recycling and electrifying our buildings – that works to sustain well-paying union jobs, which itself is another critically important priority".

Proper management of water is essential so that present and future generations may survive and flourish. We appreciate the opportunity to comment on this.

Sincerely,

Becky Evans, Sierra Club San Francisco Group Chair

A handwritten signature in blue ink that reads "Becky Evans". The signature is written in a cursive, flowing style.

From: [Joni](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); [Walton, Shamann \(BOS\)](#)
Subject: Support Re: File 210536, Alternate Water Sources for Non-Potable Applications
Date: Wednesday, September 8, 2021 2:09:31 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco's District 10 and a member of the SF Climate Emergency Coalition, I strongly support water reuse and recycling because these things are necessary - in fact long overdue - in adapting to climate change, and also because they signify the beginning of a just transition for fossil fuel workers, in this case the pipe fitters concerned about loss of work as gas lines become obsolete.

As droughts in California become more likely and devastating every year, we in San Francisco cannot continue to use our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to use less water, and to reuse wherever possible.

I am pleased that this ordinance will allow the pipe fitters previously laying gas lines to transition to good jobs laying water-recycling pipe, without having to learn brand-new skills.

Please approve this ordinance. Thank you.

Sincerely,
Joni Eisen

From: [Helena Birecki](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); [Mar, Gordon \(BOS\)](#); [Ronen, Hillary](#)
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Wednesday, September 8, 2021 2:06:33 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As an 11-year San Francisco resident of D9 and a member of the SF Climate Emergency Coalition, I support water reuse and recycling both as

- **a necessary climate change adaptation** and
- the starting point of a **just transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. It keeps us alive; we need to take seriously the responsibility to reuse, and use less. This ordinance furthers that goal.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water-recycling pipe.

I want to thank Supervisor Mar and my Supervisor, Hillary Ronen, for already cosponsoring this ordinance and I encourage the whole Committee to recommend this ordinance to the full Board.

Sincerely,
Helena Birecki
D9 resident

From: [Elena Engel](#)
To: [Carroll, John \(BOS\)](#)
Subject: Sept 9 Public Safety and Neighborhood Services Committee, Item 5
Date: Wednesday, September 8, 2021 1:25:17 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

This letter is in support of the Alternative Water Sources Ordinance.

It seems particularly timely to reduce the size of new buildings that must provide recycled water for non-drinking water uses. With the current mega-drought and with the future looking like more of the same, the time to reuse water is here.

That this ordinance will also provide more work for pipefitters is an added bonus.

I urge you all to vote for this ordinance,

Elena Engel
Dist 9 Constituent
350SF and SF-CEC

From: ss@ssteuer.com
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); [Ronen, Hillary](#)
Subject: Support of File 210536, Water reuse & recycling ordinance
Date: Wednesday, September 8, 2021 1:17:45 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 9 I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Sincerely,
Sharon Steuer
Bernal 94110

From: [Barbara Jue](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Marstaff \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haneystaff \(BOS\)](#); ystaff@sfgov.org
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Wednesday, September 8, 2021 12:32:36 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 6 and a member of the SF Climate Emergency Coalition, I'm really proud of the progress we've made to combat climate change. There are so many facets on the harm that climate change is exacting on our communities, one of which is our current drought. I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

We all recognize that drought in California will be ever more likely and severe. Yet up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse water, and use less of it.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe. Skills like this can be re-purposed and we can be just as creative about other jobs in the same vein. We know we can generate win-win solutions like this one.

Sincerely,
Barbara Jue

From: [Derrick Johnson](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Stefani, Catherine \(BOS\)](#)
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Wednesday, September 8, 2021 12:16:45 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 2 and a member of the SF Climate Emergency Coalition, I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipes.

Sincerely,
Derrick

From: [Judy Rosenfeld](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Haney, Matt \(BOS\)](#); [Mar, Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); hilary.ronan@sfgov.org
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Wednesday, September 8, 2021 11:20:59 AM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

I live in the Mission District and am a member of the SF Climate Emergency Coalition, I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

I truly believe that we can manage the water available to us but it will take political will and some decrease of usage. We can do this. I thank you in advance for all of your efforts.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Sincerely,
Judy Rosenfeld

From: [Katie Lundsgaard](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); [Peskin, Aaron \(BOS\)](#)
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Wednesday, September 8, 2021 11:10:21 AM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

Every year we see the increasing impacts of climate change on our environment and on our city. It is becoming impossible to ignore as we experience more smoke from the wildfires exacerbated by the ongoing drought. We need to take action now to mitigate the damage that is already being caused by climate change, and that starts with water use.

As a resident of San Francisco in District 3, I support water reuse and recycling both as a

- necessary climate change adaptation and
- the starting point of a Just Transition for fossil fuel workers.

We do not have to compromise workers' jobs for this - pipefitters that have worked on gas lines can work on pipelines for water recycling.

I urge you to support the water reuse and recycling ordinance to protect our precious resources and ensure a safe future for San Franciscans.

Sincerely,
Katie Lundsgaard

From: [GRACE HUENEMANN](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar, Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); [Shammon.Walton@sfgov.org](#)
Subject: Re: File 210536, Water reuse and recycling ordinance
Date: Wednesday, September 8, 2021 12:10:48 AM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 10 concerned about climate change, I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

However, I have some concerns about the ordinance as proposed. As I understand it, neither grey nor black water goes through a purification process. If this is correct, using black water for flushing could create unhealthy and unpleasant conditions. Toilet water is presently recommended as an emergency source of drinking water. It appears that this crucial resource for times of need would be lost under the proposed ordinance. It also seems likely that San Francisco bathrooms would become known for their unpleasant odors. With regard to grey water, I object to being required to use sink runoff and foundation water to wash clothes. Would you want food scraps and dirt in your wash machine? Perhaps grey water and black water are treated, or could be treated, in ways that would solve these issues, but as it stands, the ordinance seems to open the way for unsanitary conditions.

Climate change makes drought in California ever more likely and severe, and we need to be serious about reusing, and using less. It's important to be guard our precious Hetch Hetchy water source by using it sustainably.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

I would support an ordinance that accomplishes these purposes without creating the problems that I have cited above.

Sincerely,
Grace Huenemann

670 De Haro St. Apt. 3
San Francisco, CA 94107
415-647-2405

From: [Marvis Phillips](#)
To: [Carroll, John \(BOS\)](#)
Subject: File No. 210536-Alternative water sources for Non-potable Applications
Date: Tuesday, September 7, 2021 7:51:54 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Clerk of the Board,

Please forward to all Supervisor's, (my attempt was denied)!

Please encourage all the Supervisors to support File No. 210536-Alternative Water Sources for Non-Potable use our very limited amount of water resources we have access to, extremely wisely! Here is one way to re-.Use our Non-Potable water resources, to the best event possible!

Thank you!

Sincerely,
Marvis J. Phillips
Board Chair
District 6 Community Planners

--

Marvis J. Phillips
Board Chair
District 6 Community Planners

From: [Marvis Phillips](#)
To: [Carroll, John \(BOS\)](#)
Cc: [ChanStaff \(BOS\)](#); [Haney, Matt \(BOS\)](#); Mandelmanstaff@sfgov.org; Gorden.Mar@sfgov.org; Melgarstaff@sfgov.org; Arron.Peskin@sfgov.org; Dean.Preston@sfgov.org; Hillary.Ronan@sfgov.org; Ahsha.Safai@sfgov.org; Cathrine.Stefani@sfgov.org; Shamann.Walton@sfgov.org
Subject: File no. 210526-Alternative Water Source for Non-Potable Applications
Date: Tuesday, September 7, 2021 7:37:31 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Clerk of the Board and Supervisors,

I am encouraging you to support File No. 210526, the Alternative Water Source for Non-Potable Applications, so we can reduce our use of re-useable drinking water. As we are experiencing this drought season, we must find ways of using our extremely limited resources, very wisely.

Please read and examine closely, this proposal, then vote (hopefully) in favor of this proposal. Thank you!

Sincerely,
Marvis J. Phillips
Board Chair
District 6 Community Planners
Sent from my iPad

From: [Colette Crutcher](#)
To: [Carroll, John \(BOS\)](#)
Subject: Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Tuesday, September 7, 2021 6:00:44 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco, I support water reuse and recycling both as a:

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Although the language of the law does make it seem one result of passing it will be an increase in bureaucratic micro-managing of water usage and the creation of what might seem to be a redundant secondary water system for non-potable water, dealing with the climate emergency will entail government stepping into many areas previously unregulated as we all make hard choices to stop doing many things we've always taken for granted, and start doing things—like recycling waste water—that we've never done before.

Sincerely,
Mark Roller
Bernal Heights

From: [Jo Coffey](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); [ahsha Safai](#)
Subject: Support Re: File 210536, Water Reuse and Recycling ordinance
Date: Tuesday, September 7, 2021 5:50:38 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 11, and a supporter of the SF Climate Emergency Coalition, I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Josephine Coffey
248 Dublin Street
San Francisco

From: [Z](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#)
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Tuesday, September 7, 2021 5:19:07 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 9, I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Sincerely,
Zoe Roller

Sent with [ProtonMail](#) Secure Email.

From: [Colette Crutcher](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); hillary.ronen@sf.gov
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Tuesday, September 7, 2021 4:53:33 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of Bernal Heights and a member of the SF Climate Emergency Coalition, I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Sincerely,
Colette Crutcher
316 Highland Ave
SF 94110

From: [Al Chase](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); [Mandelman, Rafael \(BOS\)](#)
Subject: Water reuse and recycling ordinance. File 210536.
Date: Tuesday, September 7, 2021 4:12:18 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

I have been a resident of San Francisco's District 8 for 29 years.

I am writing to express strong support for the Water Reuse and Recycling Ordinance. Given the current severe drought and the likely future of unprecedented and continually worsening drought due to climate change, water recycling is an absolute must.

I'm not just saying words. I have conserved and reused water manually in my home for years. We average about 15 gallons of virgin water per person per day.

San Francisco must stop needlessly wasting our clean water supply -- as we do now -- and begin treating it as the necessary ingredient for life that it is, by conserving and recycling. Water is life!

As an added benefit, this ordinance will provide workers a transition from fossil fuel pipes to pipes for reused water.

Please give your fullest support to the Water Reuse and Recycling Ordinance!

Respectfully and with urgency,

-- Al Chase
30 Clover St, SF 94114

From: [Helen Liu](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Stefani, Catherine \(BOS\)](#); [ChanStaff \(BOS\)](#); [Mar, Gordon \(BOS\)](#); [Haney, Matt \(BOS\)](#)
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Tuesday, September 7, 2021 3:48:47 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 1 and a member of the SF Climate Emergency Coalition, I support water reuse and recycling both as a **necessary climate change adaptation** and the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Sincerely,
Helen Liu
94118

From: [John Anderson](#)
To: [Carroll, John \(BOS\)](#); [Stefani, Catherine \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Haney, Matt \(BOS\)](#)
Subject: Support ordinance for recycling water
Date: Tuesday, September 7, 2021 3:32:20 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

As a District 2 member and San Francisco homeowner, I'm asking you to support the proposed ordinance for Alternate Water Sources for Non-Potable Use. Water use and recycling is an important climate change adaptation which will become more and more necessary as warmer temperatures worsen our droughts. In addition, we as a city have a duty to conserve our water as much as possible to mitigate the damage to the increasingly stressed Tuolumne river system.

The ordinance is written to place little burden on San Franciscans and is critical to securing our water supply and our credibility as a city. I hope it will have your enthusiastic support.

Thank you,
John Anderson

From: [Todd](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#)
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Tuesday, September 7, 2021 2:24:26 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 5 and a member of the SF Climate Emergency Coalition, I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Thank you,
Todd Snyder

From: [Dave Rhody](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar, Gordon \(BOS\)](#)
Subject: Water Re-Use & Recycling Ordinance
Date: Tuesday, September 7, 2021 1:49:59 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

I fully support the new 'Water Re-Use & Recycling Ordinance' sponsored by Supervisors Mandelman, Mar and Melgar. The drought we're experiencing now will continue. With the impact of climate change the SF Bay Area and California in general will not return anytime soon to the days of plenty of fresh water.

We must begin to treasure and conserve fresh water like its our own life's blood. We cannot afford to waste any of it. This new ordinance is a good step toward the goal of maximum water conservation.

Dave Rhody
District 4
San Francisco

-a member of the [Bay Area Climate Reality Project](#)

From: [Pamela Coxson](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#)
Subject: Water reuse and recycling ordinance (File 210536)
Date: Tuesday, September 7, 2021 1:03:47 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 8 and a longtime advocate of forward looking environmental policies (1997 Sustainability Plan for SF, SF Greens, and SF Climate Emergency Coalition), I support water reuse and recycling, as currently being proposed, to be both a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate trends will lead to increasing frequency and duration of drought. The measures proposed here were included in the 1997 Sustainability Plan and are even more urgently needed today. Transitioning gas pipe fitters to lay pipes for recycling water is an efficient way to jump start the infrastructure upgrades that we need for this project.

Please make this a priority.

Sincerely,

Pamela Coxson

From: [David Fairley](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); [Mandelman, Rafael \(BOS\)](#)
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Tuesday, September 7, 2021 12:39:27 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

Our current unprecedented drought should ring alarm bells: Climate change is happening now and happening to us. We need to act now both to reduce our impact and to make SF more resilient to its effects. The Water reuse and recycle ordinance would do both -- it not only reduces our need for Hetch Hetchy water, but also reduces our carbon footprint (pumping water takes energy!). There is the added benefit that it provides work for pipefitters who may lack work as we transition away from natural gas.

As a resident of San Francisco in District 8 and a member of the SF Climate Emergency Coalition, I urge you to support this measure.

Sincerely yours,

David Fairley

From: [Liliana Peliks](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); [Ronen, Hillary](#)
Subject: Support File 210536, Water reuse and recycling ordinance
Date: Tuesday, September 7, 2021 12:38:46 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 9 and a member of the SF Climate Emergency Coalition, I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Sincerely,
Liliana Peliks

From: [Gentry Higgins](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); [Preston, Dean \(BOS\)](#)
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Tuesday, September 7, 2021 12:20:20 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 5 and a member of the SF Climate Emergency Coalition, I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point, we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Sincerely,
Gentry Higgins

From: [Adrienne Gembala](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); [Mar. Gordon \(BOS\)](#); [Preston, Dean \(BOS\)](#)
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Tuesday, September 7, 2021 12:10:24 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 5 and a member of the SF Climate Emergency Coalition, I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Sincerely,

[Adrienne Gembala](#)
District 5 Resident
adriennegembala@gmail.com
661 645 5569

From: [Terri Saul](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#)
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Tuesday, September 7, 2021 8:33:53 AM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a San Francisco worker and a supporter of the SF Climate Emergency Coalition, I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Sincerely,
Terri Saul

From: [Harlo Pippenger](#)
To: [Carroll, John \(BOS\)](#)
Cc: [Mar. Gordon \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Haney, Matt \(BOS\)](#); [Melgar, Myrna \(BOS\)](#)
Subject: Support Re: File 210536, Water reuse and recycling ordinance
Date: Tuesday, September 7, 2021 8:01:38 AM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in District 7 and a member of the SF Climate Emergency Coalition, I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Sincerely,
Harlo Pippenger

From: [Gabriel Goffman](#)
To: [Carroll, John \(BOS\)](#)
Subject: Fwd: Support Re: File 210536, Water reuse and recycling ordinance
Date: Monday, September 6, 2021 9:44:10 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

----- Forwarded message -----

From: **Gabriel Goffman** <gfgoffman@gmail.com>
Date: Mon, Sep 6, 2021 at 9:34 PM
Subject: Support Re: File 210536, Water reuse and recycling ordinance
To: Stefani, Catherine (BOS) <Catherine.Stefani@sfgov.org>, john.carol@sfgov.org <john.carol@sfgov.org>
CC: Gordon.Mar@sfgov.org <Gordon.Mar@sfgov.org>, Matt.Haney@sfgov.org <Matt.Haney@sfgov.org>

Dear Public Safety and Neighborhood Services Committee,

As a resident of San Francisco in D2 and a member of the SF Climate Emergency Coalition, I support water reuse and recycling both as a

- **necessary climate change adaptation** and
- the starting point of a **Just Transition** for fossil fuel workers.

Climate change makes drought in California ever more likely and severe, and up to this point we San Franciscans have been using our precious Hetch Hetchy water source unsustainably. We need to take seriously the need to reuse, and use less.

Also, it is excellent that this ordinance will allow the pipefitters previously laying gas lines to transition to good jobs using their same skills to lay water recycling pipe.

Sincerely,

From: [Paul Wermer](#)
To: [Carroll, John \(BOS\)](#); [Haney, Matt \(BOS\)](#); [Stefani, Catherine \(BOS\)](#); [Mar, Gordon \(BOS\)](#)
Cc: [Mandelman, Rafael \(BOS\)](#); [MelgarStaff \(BOS\)](#); [Bintliff, Jacob \(BOS\)](#); [Ronen, Hillary](#)
Subject: SUPPORT: File # 210536 [Health, Business and Tax Regulations Codes - Alternate Water Sources ,for Non-Potable Applications (Sept 9 agenda item 5)
Date: Monday, September 6, 2021 4:30:36 PM

This message is from outside the City email system. Do not open links or attachments from untrusted sources.

Dear Supervisors Stefani, Haney and Mar:

It was a pleasure to review the proposed *Alternate Water Sources for Non-Potable Applications* legislation (file no. 210536) and discover that none of the things I worry about were in the draft ordinance.

As we adopt adaptation strategies to deal with climate change, we must deal with both too much water, and too little water. This legislation is an excellent step in adapting to too little water. And it is a great example of how good climate strategies are consistent with good jobs: Installing and maintaining water reuse systems is complex work calling for skilled workers.

I was pleased to see Sec 12.C.1 (f) – (h) calling on SFPUC to report on how to expand water reuse and the potential for water heating systems. This is an essential analysis, and I hope the SFPUC adopts the same quality of public outreach they used for the 2020 IRP as they develop these proposals.

I fully endorse the proposed legislation, and urge the full board to support it..

With thanks to Supervisors Mandelman, Mar, Melgar and Ronin for their work on this ordinance,

Sincerely,
Paul

--

Paul Wermer
2309 California St
San Francisco, CA 94115

paul@pw-sc.com

Introduction Form

By a Member of the Board of Supervisors or Mayor

Time stamp
or meeting date

I hereby submit the following item for introduction (select only one):

- 1. For reference to Committee. (An Ordinance, Resolution, Motion or Charter Amendment).
- 2. Request for next printed agenda Without Reference to Committee.
- 3. Request for hearing on a subject matter at Committee.
- 4. Request for letter beginning : "Supervisor inquiries"
- 5. City Attorney Request.
- 6. Call File No. from Committee.
- 7. Budget Analyst request (attached written motion).
- 8. Substitute Legislation File No.
- 9. Reactivate File No.
- 10. Topic submitted for Mayoral Appearance before the BOS on

Please check the appropriate boxes. The proposed legislation should be forwarded to the following:

- Small Business Commission
- Youth Commission
- Ethics Commission
- Planning Commission
- Building Inspection Commission

Note: For the Imperative Agenda (a resolution not on the printed agenda), use the Imperative Form.

Sponsor(s):

Subject:

The text is listed:

Signature of Sponsoring Supervisor:

For Clerk's Use Only

Introduction Form

By a Member of the Board of Supervisors or Mayor

Time stamp
or meeting date

I hereby submit the following item for introduction (select only one):

- 1. For reference to Committee. (An Ordinance, Resolution, Motion or Charter Amendment).
- 2. Request for next printed agenda Without Reference to Committee.
- 3. Request for hearing on a subject matter at Committee.
- 4. Request for letter beginning : "Supervisor [] inquiries"
- 5. City Attorney Request.
- 6. Call File No. [] from Committee.
- 7. Budget Analyst request (attached written motion).
- 8. Substitute Legislation File No. []
- 9. Reactivate File No. []
- 10. Topic submitted for Mayoral Appearance before the BOS on []

Please check the appropriate boxes. The proposed legislation should be forwarded to the following:

- Small Business Commission
- Youth Commission
- Ethics Commission
- Planning Commission
- Building Inspection Commission

Note: For the Imperative Agenda (a resolution not on the printed agenda), use the Imperative Form.

Sponsor(s):

Mandelman, Mar

Subject:

[Health, Business and Tax Regulations Codes - Alternate Water Sources for Non-Potable Applications]

The text is listed:

Ordinance amending the Health Code to 1) lower the threshold, from 250,000 to 100,000 square feet of gross floor area, for requiring that new buildings be constructed, operated, and maintained using specified alternate water sources for required non-potable uses; 2) exempt certain affordable housing projects and property uses from that requirement; 3) require that certain categories of new buildings use specific sources of nonpotable water for specific purposes; 4) require that new developments with multiple buildings install an alternate water source system serving the entire development; 5) modify certain administrative review fees; and 6) require the payment of excess use charges and penalties for failure to properly use and maintain alternate water source systems; amending the Business and Tax Regulations Code to update certain annual license fee amounts for operating alternate water source systems, and amending the Planning Department's determination under the California Environmental Quality Act.

Signature of Sponsoring Supervisor: []

For Clerk's Use Only